

Is there an airborne component to the transmission of COVID-19? : a quantitative analysis study

Clive B. Beggs¹

1. Carnegie School of Sport, Leeds Beckett University, Leeds, United Kingdom

Corresponding author:

Prof. Clive Beggs
Carnegie School of Sport
Leeds Beckett University
Fairfax Hall,
Headingley Campus,
Leeds LS6 3QT
West Yorkshire
United Kingdom

Email: c.beggs@leedsbeckett.ac.uk

Tel: +44 0113 8126293

Abstract: 300 words

Text and tables: 8142 words

Abstract

Objectives

While COVID-19 is known to be spread by respiratory droplets (which travel <2m horizontally), much less is known about its transmission via aerosols, which can become airborne and be widely distributed throughout room spaces. In order to quantify the risk posed by COVID-19 infectors exhaling respiratory aerosols in enclosed spaces, we undertook a computer modelling study to simulate transmission in an office building.

Methods

Respiratory droplet data from four published datasets were analysed to quantify the number and volume of droplets <100µm diameter produced by a typical cough and speaking event (i.e. counting from 1 to 100). This was used in a stochastic model to simulate (10,000 simulations) the number of respiratory particles, originating from a COVID-19 infector, that would be inhaled in one hour by a susceptible individual practicing socially distancing in a 5 × 5 × 2.75m office space. Several scenarios were simulated that mimicked the presence of both symptomatic and asymptomatic COVID-19 infectors.

Results

On average, each cough and speaking event produced similar numbers of droplets <100 µm diameter (median range = 955 - 1010). Computer simulations (at ventilation rate = 2AC/h) revealed that sharing the office space with a symptomatic COVID-19 infector (4 coughs per hour) for one hour resulted in the inhalation of 187.3 (median value) respiratory droplets, whereas sharing with an asymptomatic COVID-19 positive person (10 speaking events per hour) resulted in the inhalation of 482.9 droplets. Increasing the ventilation rate resulted in only modest reductions in particle numbers inhaled.

Conclusions

Given that live SARS-CoV-2 virions are known to be shed in high concentrations from the nasal cavity of both symptomatic and asymptomatic COVID-19 patients, the results suggest that individuals who share enclosed spaces with an infector may be at risk of contracting COVID-19 by the aerosol route, even when practicing social distancing.

Key words: COVID-19, SARS-CoV-2, airborne transmission, aerosol transmission, droplets, droplet nuclei, infection, buildings, social distancing

1.0 Introduction

Although it is widely acknowledged that COVID-19 is primarily transmitted by respiratory droplets [1], there is much less agreement as to whether or not the disease can also be transmitted by the airborne route [2]. Currently, the World Health Organization (WHO), while acknowledging that infectious respiratory droplets are widely liberated when COVID-19 patients cough, does not believe that airborne transmission plays any significant role in the transmission of COVID-19 [1]. Given that respiratory droplets travel through the air and are therefore technically 'airborne', this might appear at first sight to be a contradictory position to take. However, for many years the medical profession has drawn a clear distinction between diseases where transmission occurs via respiratory droplets impacting on the nasal and oral mucosae or conjunctiva, and those caused by the inhalation of small aerosol particles <5 or 10 μm in diameter (known as droplet nuclei) which are capable of reaching the alveoli in the lungs. The former involve large droplets, which once emitted are generally thought to fall rapidly to the floor, travelling <2 m horizontally from the source, whereas the latter, which includes tuberculosis (TB), is associated with droplet nuclei that are so small that they can remain suspended in air for hours, often travelling considerable distances. This distinction is important, because it forms the basis of the WHO social distancing guidelines regarding COVID-19, that require the general public should maintain a distance >1 m between individuals [1].

While the above distinction between droplet transmission and airborne transmission is widely used in medical texts, it is primarily based on clinical disease characteristics rather than on any principles of physics or aerosol science. As such, there are many inconsistencies in the position held by the WHO, and this has caused several research teams to challenge the assumption that airborne transmission does not contribute towards the spread of COVID-19 [3-8]. Chief amongst these inconsistencies is the false assumption that a clear-cut boundary exists between droplets and droplet nuclei [8-10]. In reality there is no clear demarcation between respiratory droplets and droplet nuclei - rather, there is a continuum, with the droplets rapidly reducing in size due to evaporation, with many becoming droplet nuclei that can remain suspended in the air for considerable periods of time [6, 11]. For example, it has been shown that droplets as large as 100 μm will evaporate in normal room conditions to become droplet nuclei before they can reach the floor [12-14]. Consequently, relatively large respiratory droplets, which may contain many viral particles, can rapidly reduce in size to become small droplet nuclei that can be suspended in the air and thus widely dispersed on room air currents. Indeed, some researchers investigating airborne transmission of

respiratory viruses have found the greatest viral load to be associated with small droplet nuclei. For example, Bischoff et al [15] found that up to 89% of influenza virus-carrying particles in a healthcare setting were $<4.7 \mu\text{m}$ in diameter, while Lindsley et al [16], investigating cough droplets produced by influenza patients, found 65% of the viral RNA to be in particles $<4 \mu\text{m}$, with airborne RNA recovered from 81% of the patients tested. Others have found similar results [17, 18]. Given that it has been shown that when individuals cough the vast majority of the many particles produced end up as droplet nuclei suspended in the air, with an estimated 99% of particles being $<10 \mu\text{m}$ in diameter [19], there is need to better understand the role that aerosol particles might play in the transmission of COVID-19.

While numerous texts refer to large droplets and small droplet nuclei, there is considerable confusion in the literature as to what actually constitutes each of these two classes. Earlier researchers, Wells [12] and Duguid [20] defined large droplets as having a diameter $>100 \mu\text{m}$, very much in line with the experimental work relating to droplet evaporation [13]. However, in more recent years $>10 \mu\text{m}$ has often been used [10, 21, 22], although $>5 \mu\text{m}$ has now become the accepted criteria [1, 23]. This classification being primarily based on the fact that droplet nuclei must be $<10 \mu\text{m}$ in order to reach the alveoli in the lungs [10]. As such, this has led to the ludicrous situation where respiratory particles of say $15 \mu\text{m}$ diameter, which take approximately 5 minutes to fall 2 m in still air and thus can be easily transported on room air currents [24, 25], are classified as large droplets and wrongly assumed not to become airborne. As a result, many incorrect ideas have crept into the literature that have influenced the scientific debate on COVID-19. For example, the WHO state:

“According to current evidence, COVID-19 virus is primarily transmitted between people through respiratory droplets and contact routes ... Airborne transmission is different from droplet transmission as it refers to the presence of microbes within droplet nuclei, which are generally considered to be particles $<5 \mu\text{m}$ in diameter, can remain in the air for long periods of time and be transmitted to others over distances greater than 1 m.” [1]

Even more starkly, Galton et al [23] state:

“Droplet transmission is associated with particles sized $>5 \mu\text{m}$ in diameter and airborne transmission is associated with particles sized $\leq 5 \mu\text{m}$ in diameter.” [23]

Here the WHO classify all respiratory droplets $>5\ \mu\text{m}$ as being 'large', implying that they cannot travel any great distance in the air. However, while this might be true for droplets $>100\ \mu\text{m}$ diameter, it is certainly not the case for all droplets $>5\ \mu\text{m}$ [13, 24, 25], many of which can remain suspended in the air for considerable periods of time and may contain SARS-CoV-2 viral particles [6]. Consequently, there is much confusion in the literature, as highlighted in a recent report of a COVID-19 outbreak in a crowded restaurant in Guangzhou, China [26], where, at the same time as ruling out the possibility of airborne transmission, it was reported that the outbreak was caused by droplet transmission 'prompted' by air-conditioned ventilation. This ambiguous conclusion, raises intriguing questions: were the air conditioning 'jets' strong enough to transport very large respiratory droplets $>100\ \mu\text{m}$ diameter, or was it the case that the droplets were say only 20 – 40 μm and thus relatively easy to transport? Given that rapid evaporation of the droplets would almost certainly have occurred [13, 24], it is highly likely that the 'droplets' that infected individuals in this outbreak were much less than 100 μm in diameter, in which case they could have become truly airborne as implied in subsequent analysis of the outbreak [3]. As such, it may be the case that airborne transmission of COVID-19 is being ruled out due to an incorrect understanding of the definition of 'airborne', and that in fact the aerial dissemination of respiratory droplets $<100\ \mu\text{m}$ in diameter is contributing to the transmission of COVID-19 in enclosed spaces. Indeed, recent work demonstrating that coughs and sneezes produce gas plumes [27] that can transport droplets and droplet nuclei many meters [5, 11], suggests that droplet nuclei containing SARS-CoV-2 virions might be widely distributed in enclosed spaces if infectors are present.

Giving the considerable ambiguity surrounding the transmission of COVID-19 by aerosol particles, we designed the computer modelling study reported here in order to estimate the contribution that airborne transmission might play in the spread of COVID-19 in buildings. The study was not intended to be definitive; rather, given the many unknowns that exist, it was designed simply to yield a first approximation that might be useful to epidemiologists and public health authorities when making decisions regarding the control of COVID-19.

2.0 Methods

Given that it is an emerging infectious disease that has only recently been identified, no data exist regarding the size distribution of droplets produced by symptomatic and asymptomatic COVID-19 patients. We therefore decided to use existing published data on respiratory exhalation events (REEs) in our models; that is, data relating to the

liberation of respiratory droplets and droplet nuclei during coughing and speaking. To this end, we used datasets acquired by Loudon and Roberts [28], Duguid [20], Chao et al. [29], and Xie et al. [30] relating to droplet size distributions produced by healthy individuals when speaking and coughing. These four datasets were utilized because they all measured the droplet production associated with speaking by asking subjects to count from 1 to 100, and as such, were broadly comparable. Furthermore, with exception of Loudon and Roberts [28], all the researchers utilized the same size class intervals when presenting their distribution results, thus allowing direct comparisons between the datasets to be made.

Table 1 presents the percentage of respiratory droplets at origin (i.e. leaving the mouth) by size class for each of the four datasets. These represent the average number of droplets (as a percentage of the total) in each size class for an individual either coughing or speaking. With the exception of Xie et al [30], who reported the percentages for each size class, the percentage values presented in Table 1 were computed directly from the quantitative data reported in the various study papers [20, 28-30]. The values shown for Loudon and Roberts [28] were adjusted using the methodology presented by Nicas et al [21], which assumed that the diameter of droplets at origin was twice that of the diameter measured remotely on sample plates. In order to match Loudon and Roberts' results to the size classes used by the other researchers, we interpolated their results and mapped these onto the respective intervals shown in Table 1.

2.1 Droplet analysis

Analysis of the datasets above was undertaken using in-house algorithms written in R (R Core Team (2013). R: A language and environment for statistical computing. R Foundation for Statistical Computing, Vienna, Austria. URL <http://www.R-project.org/>). For each dataset the number of particles at origin in the various size classes was computed. Because initial infection with COVID-19 is thought primarily to involve cells in the nasal mucosae and the upper-respiratory tract [31, 32] as opposed to those in the lower respiratory tract, we were not only interested in droplet nuclei $<10\ \mu\text{m}$ diameter, but also in particles $>10\ \mu\text{m}$ that might become suspended in air. These when inhaled, would tend to impact on the nasal turbinates and cells in the upper-respiratory tract, and as such have the potential to transmit COVID-19. To this end, we used the droplet cut-off value of $<100\ \mu\text{m}$ diameter proposed by Wells [12, 14] and supported by Xie et al [13] as the criteria for identifying aerosol particles capable of transmitting the disease. Droplets $<100\ \mu\text{m}$ diameter at origin have been shown to

rapidly reduce to about 20 to 34% of their original size due to evaporation [14, 20] with the result that they can remain suspended in the air and be transported on room convection currents [6]. Using this criteria we then computed for each dataset the percentage of droplets at origin that were <100 μm in diameter.

Because variation existed between the four datasets for both the number and distribution of the respiratory droplets produced, we decided to adopt a stochastic approach to the modelling. This involved aggregating the published experimental data and computing a theoretical distribution for the total number of respiratory droplets liberated during speaking and coughing. This was done by fitting standard distributions (i.e. lognormal, Weibull and normal) to the data using the '*fitdistrplus*' package in R [33], with the best-fit being the one that exhibited the lowest *Akaike information criterion* (AIC). Random samples from the fitted distribution were then used in the various stochastic simulations to mimic the variance in droplet production that might be encountered in real life. For each simulation, the fraction of droplets <100 μm in diameter, $f_{<100}$, exhaled during a REE was computed by randomly sampling a vector containing the 100 μm diameter cut-off percentages derived from the four study datasets shown in Table 1. Having done this, the total number of droplets <100 μm in diameter, $N_{<100}$, liberated in any given simulation was computed using:

$$N_{<100} = N_t \times f_{<100} \quad (1)$$

Where: N_t is the number of respiratory droplets exhaled during the REE, whose value was determined by randomly sampling the best-fit distribution as described above.

In addition to calculating the numbers of particles in each size class for the four study datasets [20, 28-30], we also computed the volumetric fraction of the droplets <100 μm in diameter. This was done using the methodology described in Nicas et al [21], where the volume of the average droplet, v_i , in each class or 'bin' was determined using:

$$v_i = \frac{\pi(d_{\max}^4 - d_{\min}^4)}{24(d_{\max} - d_{\min})} \quad (2)$$

Where; d_{\max} and d_{\min} are the upper and lower diameter values (μm) in the respective size class bins.

The total volume, V_i , of the droplets in each size class bin was then determined using:

$$V_i = \sum_i N_i \times v_i \quad (3)$$

Where; N_i is the number of respiratory droplets in each size class bin.

2.2 Model

In order to assess the airborne risk posed by a subject infected with COVID-19 occupying an enclosed space, we constructed using algorithms written in R, an *in silico* model of a 5 x 5 x 2.75 m high office space into which we placed a single infector. These dimensions were deliberately selected because they are typical of the space that might be allocated to several office workers under conditions of social distancing. In theory, if a 2 m distancing rule were observed, then it would be possible to accommodate up to 6 individuals in a space with these dimensions. However, in our study, in addition to the infector we placed just one susceptible individual in the space, who was assumed to be located >2 m away from the infector and therefore out of range of any large ballistic droplets. This individual was assumed to have a pulmonary ventilation rate (minute ventilation rate) of 6 L/min, which is typical for an adult performing sedentary work [34]. Analysis was performed initially using a default ventilation rate of 2 air changes per hour (AC/h) in the office space, and thereafter for a range of ventilation rates from 1-10 AC/h.

In the model we assumed that all particles <100 μm diameter liberated by a REE would quickly deduce in size due to evaporation to form small aerosol particles [13, 24] suspended in the air. Respiratory droplets >100 μm diameter were assumed to fall to the floor. We also assumed that the room air was completely mixed (which in most room spaces is a reasonable approximation [35]) and that any airborne particles produced by a REE would quickly become evenly dispersed throughout the room space. Thereafter, the concentration of the particles in the room air would fall exponentially according to equation 4, as deposition and the ventilation system removed aerosols from the air.

$$C_t = C_0 \times e^{-(k_v+k_d)t} \quad (4)$$

Where: C_0 and C_t are the concentrations of respiratory particles in the air (particles/ m^3) at time zero and t hours respectively; k_v is the room ventilation rate (air changes per

hour); k_d is the particle deposition rate constant (set at 5.1986 h^{-1} in accordance with experimental work by Stadnytskyi et al. [6]); and t is time in hours.

2.3 Simulations

In order to quantify the risks associated with an infector located in the room space, we simulated the scenarios listed in Table 2. These scenarios were chosen because they approximated to situations that might be encountered in real life. Scenarios 1 and 2 were intended to mimic the situation where a susceptible person occupies a room space in which an infector has recently vacated. This involved an infector coughing once (Scenario 2) or speaking (Scenario 1) at time $t = 0$ seconds and then leaving the room space, while the susceptible individual remained present for an hour. By contrast, scenario 3 and 4 were intended to simulate the situation where both the infector, who may be asymptomatic (or pre-symptomatic) (Scenario 3) or symptomatic (Scenario 4), and the susceptible individual share the space for an hour.

For all scenarios the model simulated the total number of particles (infectious or not) that would be inhaled by a susceptible individual occupying the office space for an hour. In order to assess the variance associated with this, the simulations were repeated 10,000 times so that the distribution of the likely outcomes could be assessed. For all the scenarios the number of inhaled particles was computed for a range of room ventilation rates (i.e. 1, 2, 4, 6, 8 and 10 AC/h).

3.0 Results

The results of the droplet distribution analysis for the four study datasets are presented in Figure 1, which shows the percentage breakdown, by size class, of the number of respiratory particles liberated at the mouth by: (i) counting from 1 to 100 (Figure 1(a)); and (ii) a single cough (Figure 1(b)). From these, and the results of the droplet analysis (Table 3), it can be seen that on average, during speaking 88.2% (range = 80.1 - 94.4%) of the droplets produced were $<100 \mu\text{m}$ in diameter, whereas for coughing this figure was 84.9% (range = 61.2 - 96.0%). By comparison, most of the volume associated with the exhaled respiratory fluid resided in the larger droplets. On average, 96.4% (range = 88.3 - 99.5%) of the total fluid volume expressed during speaking was contained in droplets $>100 \mu\text{m}$ in diameter, with this value rising to 99.3% (range = 98.9 - 99.8%) for coughing.

Analysis of the findings of Loudon and Roberts [28], Duguid [20], Chao et al. [29], and Xie et al. [30] regarding the total number of droplets liberated suggested that, although

great variation exists between individuals and REEs, the distribution of the aggregated results for the total number of droplets produced broadly conformed to a lognormal function, with a geometric mean (GM) of 1113.0 and a geometric standard deviation (GSD) of 2.902 for speaking (AIC = 72.0), and GM = 1150.5 and GSD = 2.423 for coughing (AIC = 70.8). This meant that the best-fit distributions for the total number of droplets produced by the REEs were heavily positively (right) skewed, with skewness values of 0.53 and 0.73 observed for speaking and coughing respectively. So although the mean number of droplets produced during speaking and coughing were 1829 and 1796 respectively, the median values were only 1263 and 874 respectively. As such, these values appear to sit comfortably within the ranges estimated by Chao et al. [29] (i.e. 112–6720 droplets expelled during speaking and 947–2085 droplets were expelled per cough).

The results of the office space simulations using the default ventilation rate of 2 AC/h are presented in figures 2-4 and in Table 4. These show that for all scenarios, appreciable numbers of aerosolised respiratory particles originating from the infector were inhaled by the susceptible individual after one hour in the room space. For example, spending one hour in the space after the infector had spoken (Scenario 1) or coughed (Scenario 2) just once, resulted in a median value of 49.7 and 47.7 particles respectively being inhaled. These median values increased to 482.9 and 187.3 respectively for scenarios 3 and 4.

From figures 2(b), 3(b) and 4(b) it can be seen that distribution of inhaled respiratory particles was highly positively skewed (skewness = 5.68; 4.83; and 3.69 respectively). So while many of the simulations produced inhalation results that were relatively close to the median value, a few resulted in much higher inhalation values. For example, in Table 4 it can be seen that 10% of the simulations resulted in the inhalation of: >192 particles (Scenario 1); >156 particles (Scenario 2); >1906 particles (Scenario 3); and >603 particles (Scenario 4). As such, this suggests that a minority of individuals in the vicinity of a COVID-19 positive individual for an hour will inhale relatively large numbers of aerosolised respiratory droplets.

The impact of changing the room ventilation rate is shown in Table 5. This shows that increasing the ventilation rate had an exponential effect on the numbers of particles inhaled. However, this effect was relatively modest, with a five-fold increase in ventilation rate from 2 to 10 AC/h approximately halving the median number of particles inhaled for all scenarios.

4.0 Discussion

While the results presented above should be treated with caution because of the limited data available and the assumptions made, they do however suggest that if susceptible individuals spend relatively short periods of time (i.e. in the region of one hour) indoors in the presence of someone who is coughing or even just talking, then they are likely to inhale appreciable numbers of respiratory particles. This is despite being out of the range of ballistic respiratory droplets, which are generally thought not to travel more than 2 m. In reality the amount inhaled will of course depend on many factors, including: the time spent in each other's presence; the ventilation rate; the number of times that REEs occur; and the quantity and distribution of any respiratory particles produced by each REE. Therefore, the simulation results should be treated as a first approximation and should be considered indicative only. However, notwithstanding these limitations, they appear to have value because they imply that if someone with COVID-19 is present in an enclosed space, others in that space are at risk of inhaling appreciable numbers of particles, some of which might bear SARS-CoV-2 virions, even when practicing social distancing. As such, this supports the findings of other studies suggesting that airborne transmission of COVID-19 may be taking place [3, 6].

Of course, the inhalation of respiratory droplets and droplet nuclei produced by COVID-19 positive individuals does not necessarily mean that any infection will be transmitted. This is because the infectious dose received may not reach the threshold necessary to cause an infection, and also because the host's immunological status might mean that they are less susceptible to COVID-19. While the minimum infectious dose necessary to cause a COVID-19 infection is not known, it has been recently shown that the average virus RNA load in the sputum of hospitalised COVID-19 patients is 7.00×10^6 copies per mL, rising to a maximum of 2.35×10^9 copies per mL [36]. If we apply this average value to the results of the analysis presented in Table 3, it suggests that on average a subject infected with COVID-19 would exhale a total of 38423 viral copies (i.e. $0.005489 \text{ mL} \times 7.00 \times 10^6 \text{ copies per mL}$) whilst speaking. Similarly, an average cough would liberate 43302 viral copies. However, most of these virus copies would quickly fall to the floor with only about 1384 and 298 viral copies (for speaking and coughing respectively) ending up in aerosolised particles. If these viral copies were shared out evenly between the 994 and 955 (median values) aerosolised droplets exhaled during an average 'speaking event' and cough in scenarios 1 and 2 (Table 4), then at a rough estimate it would mean that at least one viral copy would be present in

approximately every three droplets. However, this is unlikely because the larger aerosol particles are likely to contain more viral copies than the smaller ones. Also, we cannot be sure that individuals who are asymptomatic, or who display mild COVID-19 symptoms, will exhibit the same viral load as hospitalised patients, although it has been found that symptomatic and asymptomatic patients display similar viral loads [37]. So crude calculations of this nature are unlikely to be correct. Nevertheless, despite being simplistic, the calculation does suggest that a substantial proportion of the aerosolised respiratory droplets liberated during a cough or speaking will contain SARS-CoV-2 virus copies. As such, this appears to support Stadnytskyi et al's [6] estimate that the probability of a 50 μm diameter droplet, prior to dehydration, containing at least one virion is approximately 37%. If the *independent action hypothesis* (IAH), which states that each virion has an equal, nonzero probability of causing an infection [38], is applicable to COVID-19 infection in humans, then in theory the inhalation of the numbers of respiratory particles reported in Table 4, should be enough to seed COVID-19 infection in a proportion of the individuals exposed. However, the extent to which the IAH is valid for humans and SARS-CoV-2 has not been established, although it has been shown that the IAH applies to systems where the host is highly susceptible to the disease [39].

The results of the office space simulation highlight the crucial importance of identifying and excluding where possible COVID-19 positive individuals. In the simulations, by far the greatest threat was posed by the individual who while being COVID-19 positive was asymptomatic, or pre-symptomatic (Scenario 3). Because they were undiagnosed and displayed no obvious symptoms, there was nothing to alert susceptible individuals to any threat. Consequently, it is likely that no evasive action would be taken, other than social distancing, with the result that over the course of a typical working week, susceptible individuals in the vicinity of the asymptomatic person, would be exposed to many hundreds of aerosol particles that might contain SARS-CoV-2 virions. As such, our model suggests that undiagnosed COVID-19 positive individuals who are either asymptomatic or pre-symptomatic play an important role in the airborne transmission of COVID-19 in buildings and other enclosed spaces, even when social distancing is observed. Indeed, given that live coronavirus is thought to be shed in high concentrations from the nasal cavity of COVID-19 positive individuals before symptoms develop [37, 40, 41], this finding is perhaps unsurprising. There is strong evidence that many infected individuals who transmit COVID-19 are either minimally symptomatic or asymptomatic [40, 42, 43], and while much of this transmission will occur through either direct contact or the action of ballistic droplets, our findings suggest that aerosolised

viral particles may also be contributing to the spread of the infection. With this in mind, it is worth remembering that people behave very much like involuntary air samplers. The longer they remain within a space containing an infectious person, the more likely they are to acquire (sample) an infectious dose that might lead to disease. In the simulations shown in figures 3 and 4, we assumed that the infectious and susceptible individuals shared the same space for just one hour. In reality however, in a work place situation or, say, on a long journey in a vehicle, the two might be in the same vicinity for many hours, in which case the risk of one acquiring an infection from the other will greatly increase [44]. Similarly, if we placed multiple air samples in a room space containing an infectious person, then it would be much more likely that one or more of the samplers would return a positive result compared to the situation were a single sampler was used. In other words, if we were to place say ten susceptible individuals in the office space in our simulation, then it would be much more likely that at least one might become infected within the hour. As such, this suggests that it is important to maintain low occupancy densities within enclosed spaces, as well as managing occupancy levels so that likelihood of susceptibles and unidentified infectors sharing a room space for any length of time is minimized [45].

Unlike diseases such as TB, where infectious particles need to travel to the alveoli in order to cause an infection, COVID-19 is primarily associated with viral particles coming into contact with the ACE-2 receptors in the nasopharyngeal region and upper respiratory tract [46]. As such, inhaled particles do not need to be $<10\ \mu\text{m}$ in diameter in order to infect an individual, rather they can be any size. This means that larger particles, say in the region $50\text{-}10\ \mu\text{m}$, that can remain suspended in air for long enough to contaminate a mechanical ventilation system [11], can transmit the disease. Particles of this size, which often occur due to the evaporation of larger droplets [13, 24], behave as aerosol particles and can be transported on room air currents [24, 25], with the result that they can become widely dispersed, particularly if the air is turbulent. Recently, it has been shown that coughs and sneezes produce not only mucosalivary droplets but also a multiphase turbulent gas cloud that entrains the air, trapping and carrying within it clusters of droplets, both large and small, in a manner that allows the contained droplets to evade evaporation for much longer than would otherwise be the case [5]. Under these conditions, droplets of all sizes can be transported as much as 7-8 m through the air [5, 11]. This supports the findings of other researchers [13, 24, 25, 47], all of whom found that droplets $>10\ \mu\text{m}$ diameter could be transported $>3\ \text{m}$. Collectively, this shows the traditional binary demarcation between droplets and droplet nuclei (<5 or $10\ \mu\text{m}$) to be an outdated concept [8-10]. Rather, every REE produces a

continuum of respiratory particles, many of which can remain suspended in room air allowing them to become widely dispersed. Failure to recognise this fact, can lead to the erroneous conclusion that all 'droplets' (i.e. $<5\ \mu\text{m}$ diameter) rapidly fall to the ground, thus posing no risk to room occupants $>2\ \text{m}$ away.

One of the major problems (which is largely unrecognised) associated with using the binary cut-off of $<5\ \mu\text{m}$ to distinguish droplet nuclei from droplets, is that it promotes confusion and ambiguity, so that if an infection is caused by the inhalation of, say, a $20\ \mu\text{m}$ diameter respiratory particle, the incident might be taken as evidence of airborne transmission by an aerosol (indoor air) scientist, whereas to a clinician, the same event would be interpreted as an example of droplet transmission. This ambiguity unfortunately all too often results in polarized views and a loss of nuance. So for example, influenza A, which shares some similar transmission characteristics to COVID-19, is classified as a disease that is spread by droplet transmission, despite the fact that numerous studies have shown that influenza RNA has been recovered from droplet nuclei $<5\ \mu\text{m}$ in diameter, either directly from influenza patients [15, 16, 18], or from the air in healthcare facilities [17] and other settings [48, 49]. There have also been outbreaks of influenza that have been attributed to airborne transmission. Perhaps the most notorious of these occurred in the 1970s when a commercial airplane with a 56-seat passenger compartment was delayed due to engine trouble, so that the passengers had to wait on board for 4.5 hours with no mechanical ventilation. In this incident, a single index patient, who became ill with influenza within 15 minutes after boarding the plane, managed to infect 72% of the 54 passengers on board with influenza [50]. Furthermore, Cowling et al [51], investigating influenza A outbreaks in Hong Kong and Bangkok, concluded that aerosol transmission accounted for approximately 50% of all transmission events, and Coleman and Sigler [48], sampling the air in a public elementary school, found airborne influenza A virus densities to be high enough to infect individuals within minutes. Of particular note, Coleman and Sigler also found that the viral RNA was concentrated in droplet nuclei $<4\ \mu\text{m}$ in diameter, rather than larger 'droplets', a finding mirrored by other researchers [15, 16, 18]. This is interesting because early studies on influenza in humans found that illness could be induced with substantially lower virus titers when administered as a small droplet aerosol rather than by nasal droplets, suggesting that infection is induced more efficiently when virus is deposited in the lower respiratory tract rather than the upper respiratory tract [52]. If this is the case, then it might be that with influenza, small virus laden droplet nuclei pose a greater threat than larger droplets, or at least contribute to the spread of the disease [53].

COVID-19, like influenza, is caused by an enveloped RNA virus, so it might be expected that it too will survive in the air. Indeed, it has been shown that SARS-CoV-2 can remain viable in aerosols for up to 3 hours [54]. Aerosol transmission has also been demonstrated for SARS (SARS-CoV-1) [55-57], which is closely related to COVID-19. Consequently, there is good reason to believe that aerial dissemination of respiratory droplets <100 µm together with droplet nuclei might play an important role in the transmission of COVID-19. However, the evidence to support this is only just emerging. For example, Ong et al [58], who sampled surfaces in hospital rooms containing COVID-19 patients, found extensive fomite contamination for some patient rooms, with air exhaust outlets in particular testing positive. From this they concluded that virus-laden droplet nuclei were being transported on air currents. Air conditioning has also been implicated in an outbreak that occurred in restaurant in Guangzhou, China [26] (as discussed above), where a index patient infected five unrelated diners. In this outbreak it was shown that because the space was poorly ventilated, a contaminated recirculation envelope was created which sustained a high concentration of exhaled droplet nuclei from the index patient to diners on neighbouring tables [3]. Liu et al [59] investigating the airborne transmission of COVID-19 in hospitals in Wuhan, China, found elevated levels of SARS-CoV-2 in the air in the patient toilets and also in medical staff areas, suggesting that aerosol dissemination might be an important pathway for surface contamination. Santarpia et al [60] also observed extensive viral shedding at the University of Nebraska Medical Center, which led to extensive environmental contamination. Importantly, they found that patient room air samples were 63.2% positive by RT-PCR, with a mean concentration of 2.86 copies/L of air. Samples taken outside the patient rooms in the hallways were 66.7% positive, with a mean concentration of 2.59 copies/L of air. From this they concluded that *“viral aerosol particles are produced by individuals that have the COVID-19 disease, even in the absence of cough”*, and that *“virus-containing particles were being transported from the rooms to the hallway during sampling activities”*. Furthermore, they found that the *“personal air samplers worn by sampling personnel were all positive for SARS-CoV-2, despite the absence of cough by most patients while sampling personnel were present”*. Collectively, this suggest that transmission of COVID-19 may well be occurring by the airborne route, as well as by the droplet route, supporting the findings of our study.

5.0 Conclusions

In conclusion, our study suggests that the aerial dissemination of small aerosol particles containing SARS-CoV-2 virions is probably a feature of COVID-19. These particles can be suspended in air for considerable periods of time and thus can be widely dispersed. Although the analysis presented here suggest that airborne transmission of COVID-19 is likely to be occurring, particularly from asymptomatic individuals, the extent to which aerosol particles contribute to the overall burden of the disease is unclear, in part, because of ambiguity and confusion regarding the distinction between droplets and droplet nuclei. Given that unreported airborne transmission of COVID-19 may well be occurring, it is recommended that further detailed work be undertaken to inform public health policy and guidelines on occupancy levels in buildings and other enclosed spaces.

References

1. World Health O. Modes of transmission of virus causing COVID-19: implications for IPC precaution recommendations: scientific brief, 27 March 2020. World Health Organization, 2020.
2. Lewis D. Is the coronavirus airborne? Experts can't agree. *Nature*. 2020.
3. Li Y, Qian H, Hang J, Chen X, Hong L, Liang P, et al. Evidence for probable aerosol transmission of SARS-CoV-2 in a poorly ventilated restaurant. *medRxiv*. 2020.
4. Morawska L, Cao J. Airborne transmission of SARS-CoV-2: the world should face the reality. *Environment International*. 2020:105730.
5. Bourouiba L. Turbulent Gas Clouds and Respiratory Pathogen Emissions: Potential Implications for Reducing Transmission of COVID-19. *Jama*. 2020. PubMed PMID: 32215590.
6. Stadnytskyi V, Bax CE, Bax A, Anfinrud P. The airborne lifetime of small speech droplets and their potential importance in SARS-CoV-2 transmission. *Proceedings of the National Academy of Sciences*. 2020.
7. Asadi S, Bouvier N, Wexler AS, Ristenpart WD. The coronavirus pandemic and aerosols: Does COVID-19 transmit via expiratory particles? *Aerosol Sci Technol*. 2020;54(6):635-8.
8. Bahl P, Doolan C, de Silva C, Chughtai AA, Bourouiba L, MacIntyre CR. Airborne or droplet precautions for health workers treating COVID-19? *J Infect Dis*. 2020. PubMed PMID: 32301491.
9. Setti L, Passarini F, De Gennaro G, Barbieri P, Perrone MG, Borelli M, et al. Airborne Transmission Route of COVID-19: Why 2 Meters/6 Feet of Inter-Personal Distance Could Not Be Enough. *Int J Environ Res Public Health*. 2020;17(8). PubMed PMID: 32340347.
10. Gralton J, Tovey E, McLaws ML, Rawlinson WD. The role of particle size in aerosolised pathogen transmission: a review. *J Infect*. 2011;62(1):1-13. PubMed PMID: 21094184.
11. Bourouiba L, Dehandschoewercker E, Bush JWM. Violent expiratory events: on coughing and sneezing. *Journal of Fluid Mechanics*. 2014;745:537-63.
12. Wells WF. *Airborne Contagion and Air Hygiene. An Ecological Study of Droplet Infections*. Cambridge, MA: Harvard University Press; 1955.
13. Xie X, Li Y, Chwang AT, Ho PL, Seto WH. How far droplets can move in indoor environments--revisiting the Wells evaporation-falling curve. *Indoor Air*. 2007;17(3):211-25. PubMed PMID: 17542834.

14. Wells WF. On Airborne Infection-Study. II. Droplets and Droplet Nuclei, *Amn J Hyg.* 1934;30:611-8.
15. Bischoff WE, Swett K, Leng I, Peters TR. Exposure to influenza virus aerosols during routine patient care. *J Infect Dis.* 2013;207(7):1037-46. PubMed PMID: 23372182.
16. Lindsley WG, Blachere FM, Thewlis RE, Vishnu A, Davis KA, Cao G, et al. Measurements of airborne influenza virus in aerosol particles from human coughs. *PLoS One.* 2010;5(11):e15100. PubMed PMID: 21152051.
17. Lindsley WG, Blachere FM, Davis KA, Pearce TA, Fisher MA, Khakoo R, et al. Distribution of airborne influenza virus and respiratory syncytial virus in an urgent care medical clinic. *Clin Infect Dis.* 2010;50(5):693-8. PubMed PMID: 20100093.
18. Yan J, Grantham M, Pantelic J, Bueno de Mesquita PJ, Albert B, Liu F, et al. Infectious virus in exhaled breath of symptomatic seasonal influenza cases from a college community. *Proc Natl Acad Sci U S A.* 2018;115(5):1081-6. PubMed PMID: 29348203.
19. Zayas G, Chiang MC, Wong E, MacDonald F, Lange CF, Senthilselvan A, et al. Cough aerosol in healthy participants: fundamental knowledge to optimize droplet-spread infectious respiratory disease management. *BMC Pulm Med.* 2012;12:11. PubMed PMID: 22436202.
20. Duguid JP. The size and the duration of air-carriage of respiratory droplets and droplet-nuclei. *J Hyg (Lond).* 1946;44(6):471-9. PubMed PMID: 20475760.
21. Nicas M, Nazaroff WW, Hubbard A. Toward understanding the risk of secondary airborne infection: emission of respirable pathogens. *J Occup Environ Hyg.* 2005;2(3):143-54. PubMed PMID: 15764538.
22. Christian MD, Loutfy M, McDonald LC, Martinez KF, Ofner M, Wong T, et al. Possible SARS coronavirus transmission during cardiopulmonary resuscitation. *Emerg Infect Dis.* 2004;10(2):287-93. PubMed PMID: 15030699.
23. Gralton J, Tovey ER, McLaws ML, Rawlinson WD. Respiratory virus RNA is detectable in airborne and droplet particles. *J Med Virol.* 2013;85(12):2151-9. PubMed PMID: 23959825.
24. Liu L, Wei J, Li Y, Ooi A. Evaporation and dispersion of respiratory droplets from coughing. *Indoor Air.* 2017;27(1):179-90. PubMed PMID: 26945674.
25. Wei J, Li Y. Enhanced spread of expiratory droplets by turbulence in a cough jet. *Building and Environment.* 2015;93:86-96.
26. Lu J, Gu J, Li K, Xu C, Su W, Lai Z, et al. COVID-19 Outbreak Associated with Air Conditioning in Restaurant, Guangzhou, China, 2020. *Emerging Infectious Diseases.* 2020;26(7).
27. Scharfman BE, Techet AH, Bush JWM, Bourouiba L. Visualization of sneeze ejecta: steps of fluid fragmentation leading to respiratory droplets. *Exp Fluids.* 2016;57(2):24. PubMed PMID: 32214638.
28. Loudon RG, Roberts RM. Droplet expulsion from the respiratory tract. *American Review of Respiratory Disease.* 1967;95(3):435-42.
29. Chao CYH, Wan MP, Morawska L, Johnson GR, Ristovski ZD, Hargreaves M, et al. Characterization of expiration air jets and droplet size distributions immediately at the mouth opening. *Journal of Aerosol Science.* 2009;40(2):122-33.
30. Xie X, Li Y, Sun H, Liu L. Exhaled droplets due to talking and coughing. *J R Soc Interface.* 2009;6 Suppl 6:S703-14. PubMed PMID: 19812073.
31. GroB S, Jahn C, Cushman S, Bar C, Thum T. SARS-CoV-2 receptor ACE2-dependent implications on the cardiovascular system: From basic science to clinical implications. *Journal of Molecular and Cellular Cardiology.* 2020.
32. Rajagopaian S, Huang S, Brook RD. Flattening the curve in COVID-19 using personalised protective equipment: lessons from air pollution. *BMJ Publishing Group Ltd and British Cardiovascular Society;* 2020.

33. Delignette-Muller ML, Dutang C. fitdistrplus: An R package for fitting distributions. *Journal of statistical software*. 2015;64(4):1-34.
34. Petrini MF, Peterson BT, Hyde RW. Lung tissue volume and blood flow by rebreathing theory. *Journal of Applied Physiology*. 1978;44(5):795-802.
35. Beggs CB, Sleigh PA. A quantitative method for evaluating the germicidal effect of upper room UV fields. *Journal of Aerosol Science*. 2002;33(12):1681-99.
36. Wolfel R, Corman VM, Guggemos W, Seilmaier M, Zange S, Muller MA, et al. Virological assessment of hospitalized patients with COVID-2019. *Nature*. 2020:1-5.
37. Zou L, Ruan F, Huang M, Liang L, Huang H, Hong Z, et al. SARS-CoV-2 viral load in upper respiratory specimens of infected patients. *New England Journal of Medicine*. 2020;382(12):1177-9.
38. Druett HA. Bacterial invasion. *Nature*. 1952;170(4320):288-.
39. Zwart MP, Hemerik L, Cory JS, de Visser JAGM, Bianchi FJJA, Van Oers MM, et al. An experimental test of the independent action hypothesis in virus-insect pathosystems. *Proceedings of the Royal Society B: Biological Sciences*. 2009;276(1665):2233-42.
40. Gandhi M, Yokoe DS, Havlir DV. Asymptomatic transmission, the Achillesâ€™ heel of current strategies to control COVID-19. *Mass Medical Soc*; 2020.
41. Arons MM, Hatfield KM, Reddy SC, Kimball A, James A, Jacobs JR, et al. Presymptomatic SARS-CoV-2 infections and transmission in a skilled nursing facility. *New England Journal of Medicine*. 2020.
42. Chan JF-W, Yuan S, Kok K-H, To KK-W, Chu H, Yang J, et al. A familial cluster of pneumonia associated with the 2019 novel coronavirus indicating person-to-person transmission: a study of a family cluster. *The Lancet*. 2020;395(10223):514-23.
43. Hu Z, Song C, Xu C, Jin G, Chen Y, Xu X, et al. Clinical characteristics of 24 asymptomatic infections with COVID-19 screened among close contacts in Nanjing, China. *Science China Life Sciences*. 2020:1-6.
44. Beggs CB, Noakes CJ, Sleigh PA, Fletcher LA, Siddiqi K. The transmission of tuberculosis in confined spaces: an analytical review of alternative epidemiological models. *Int J Tuberc Lung Dis*. 2003;7(11):1015-26. PubMed PMID: 14598959.
45. Beggs CB, Shepherd SJ, Kerr KG. Potential for airborne transmission of infection in the waiting areas of healthcare premises: stochastic analysis using a Monte Carlo model. *BMC Infect Dis*. 2010;10:247. PubMed PMID: 20727178.
46. Vaduganathan M, Vardeny O, Michel T, McMurray JJV, Pfeffer MA, Solomon SD. Renin-Angiotensin-Aldosterone System Inhibitors in Patients with Covid-19. *N Engl J Med*. 2020;382(17):1653-9. PubMed PMID: 32227760.
47. Parienta D, Morawska L, Johnson GR, Ristovski ZD, Hargreaves M, Mengersen K, et al. Theoretical analysis of the motion and evaporation of exhaled respiratory droplets of mixed composition. *Journal of aerosol science*. 2011;42(1):1-10.
48. Coleman KK, Sigler WV. Airborne Influenza A Virus Exposure in an Elementary School. *Scientific Reports*. 2020;10(1):1-7.
49. Yang W, Elankumaran S, Marr LC. Concentrations and size distributions of airborne influenza A viruses measured indoors at a health centre, a day-care centre and on aeroplanes. *Journal of the Royal Society Interface*. 2011;8(61):1176-84.
50. Moser MR, Bender TR, Margolis HS, Noble GR, Kendal AP, Ritter DG. An outbreak of influenza aboard a commercial airliner. *American journal of epidemiology*. 1979;110(1):1-6.
51. Cowling BJ, Ip DK, Fang VJ, Suntarattiwong P, Olsen SJ, Levy J, et al. Aerosol transmission is an important mode of influenza A virus spread. *Nat Commun*. 2013;4:1935. PubMed PMID: 23736803.

52. Alford RH, Kasel JA, Gerone PJ, Knight V. Human influenza resulting from aerosol inhalation. *Proceedings of the Society for Experimental Biology and Medicine*. 1966;122(3):800-4.
53. Bridges CB, Kuehnert MJ, Hall CB. Transmission of influenza: implications for control in health care settings. *Clinical infectious diseases*. 2003;37(8):1094-101.
54. van Doremalen N, Bushmaker T, Morris DH, Holbrook MG, Gamble A, Williamson BN, et al. Aerosol and surface stability of SARS-CoV-2 as compared with SARS-CoV-1. *New England Journal of Medicine*. 2020.
55. Chu C-M, Cheng VCC, Hung IFN, Chan K-S, Tang BSF, Tsang THF, et al. Viral load distribution in SARS outbreak. *Emerging infectious diseases*. 2005;11(12):1882.
56. Booth TF, Kournikakis B, Bastien N, Ho J, Kobasa D, Stadnyk L, et al. Detection of airborne severe acute respiratory syndrome (SARS) coronavirus and environmental contamination in SARS outbreak units. *The Journal of infectious diseases*. 2005;191(9):1472-7.
57. Li Y, Huang X, Yu IT, Wong TW, Qian H. Role of air distribution in SARS transmission during the largest nosocomial outbreak in Hong Kong. *Indoor air*. 2005;15(2):83-95.
58. Ong SWX, Tan YK, Chia PY, Lee TH, Ng OT, Wong MSY, et al. Air, surface environmental, and personal protective equipment contamination by severe acute respiratory syndrome coronavirus 2 (SARS-CoV-2) from a symptomatic patient. *Jama*. 2020.
59. Liu Y, Ning Z, Chen Y, Guo M, Liu Y, Gali NK, et al. Aerodynamic characteristics and RNA concentration of SARS-CoV-2 aerosol in Wuhan hospitals during COVID-19 outbreak. *bioRxiv*. 2020.
60. Santarpia JL, Rivera DN, Herrera V, Morwitzer MJ, Creager H, Santarpia GW, et al. Transmission potential of SARS-CoV-2 in viral shedding observed at the University of Nebraska Medical Center. *medRxiv*. 2020.

Tables

Table 1. Percentage of respiratory droplets by size class at origin derived from experimental results by Loudon and Roberts [28], Duguid [20], Chao et al. [29], and Xie et al. [30].

Size Range (µm)	Size Class (µm)	Loudon & Roberts [28] Speaking (n)	Loudon & Roberts [28] Cough (n)	Duguid [20] Speaking (n)	Duguid [20] Cough (n)	Chao et al. [29] Speaking (n)	Chao et al. [29] Cough (n)	Xie et al. [30] Speaking (n)	Xie et al. [30] Cough (n)
1–2	1.5	NA	NA	0.4	1.0	NA	NA	0.0	0.0
2–4	3.0	2.8	24.5	5.2	5.8	2.8	3.6	0.0	0.0
4–8	6.0	1.6	10.3	20.6	19.5	44.3	50.0	0.1	0.0
8–16	12.0	6.4	1.4	31.0	32.2	15.2	18.5	0.3	0.0
16–24	20.0	14.1	6.3	15.9	17.5	7.9	6.1	0.1	0.3
24–32	28.0	19.7	13.5	9.5	8.5	5.3	2.3	0.2	0.0
32–40	36.0	17.3	13.2	4.8	4.8	2.6	2.2	0.2	0.5
40–50	45.0	14.5	12.3	2.4	2.2	2.8	1.8	8.9	6.2
50–75	62.5	10.9	8.7	2.8	2.8	3.0	1.8	51.1	30.8
75–100	87.5	4.8	4.7	2.0	1.7	2.2	1.3	19.3	23.4
100–125	112.5	2.4	1.8	1.6	1.0	2.8	1.5	8.3	15.0
125–150	137.5	1.1	0.9	1.2	0.8	2.6	1.5	4.6	5.9
150–200	175.0	2.4	0.6	0.8	0.7	2.8	4.0	4.0	7.4
200–250	225.0	1.2	0.7	0.4	0.6	2.5	2.3	1.3	3.4
250–500	375.0	0.6	0.6	1.2	0.7	2.3	1.9	1.6	4.5
500–1000	750.0	0.1	0.3	0.4	0.2	0.8	1.3	0.1	2.4
1000–2000	1500.0	0.2	0.3	0.0	0.0	0.0	0.0	0.0	0.2
Reported average number of droplets per person (n)	NA	1765	465	252	4973	4539	947	760	800

Legend: NA – Not applicable

Table 2. Details of the various scenarios simulated in the study.

Scenario	REE type	Number of REEs per hour	Simulation duration (hours)	Description
1	Speaking	1	1	A single 'talking event' occurring at the start of the hour. One susceptible individual present throughout.
2	Cough	1	1	A single cough occurring at the start of the hour. One susceptible individual present throughout.
3	Speaking	10	1	The same 'talking event' repeated ten times in an hour, evenly spaced. One susceptible individual present throughout.
4	Cough	4	1	The same 'cough' repeated four times in an hour, evenly spaced. One susceptible individual present throughout.

Legend: REE – respiratory exhalation event

Table 3. Results of analysis of droplet distributions by number and volume.

	Loudon & Roberts [28]	Loudon & Roberts [28]	Duguid [20]	Duguid [20]	Chao et al. [29]	Chao et al. [29]	Xie et al. [30]	Xie et al. [30]
	Speaking	Coughing	Speaking	Coughing	Speaking	Coughing	Speaking	Coughing
Total number of particles (n)	1765	465	252	4973	4539	947	760	800
Total volume of particles (mL)	0.006828	0.003062	0.000360	0.008352	0.013847	0.003778	0.000921	0.009552
No. of particles <100 µm (n)	1626	441	238	4775	3909	829	609	490
Volume of particles <100 µm (mL)	0.000083	0.000019	0.000004	0.000073	0.000070	0.000009	0.000108	0.000104
No. of particles >100 µm (n)	139	24	14	198	630	118	151	310
Volume of particles >100 µm (mL)	0.006745	0.003043	0.000356	0.008279	0.013777	0.003769	0.000813	0.009448
Percentage of particles <100 µm by number (%)	92.12	94.84	94.44	96.02	86.12	87.6	80.13	61.25
Percentage of particles <100 µm by volume (%)	1.19	0.60	1.07	0.85	0.49	0.23	11.66	1.07

Table 4. Results of office space simulations (n = 10000), assuming a default ventilation rate of 2 AC/h.


Scenario	REE type	Number of REEs per hour	Simulation duration (hours)	Number of droplets <100 µm exhaled per REE (mean [median])	Total number of droplets inhaled (mean [median])	Range of droplets inhaled (min – max)	90 th percentile value (n)
1	Speaking	1	1	1760.5 [994.0]	88.0 [49.7]	0.8 – 2086.7	192.0
2	Cough	1	1	1459.1 [955.1]	72.9 [47.7]	1.5 – 1132.2	156.2
3	Speaking	10	1	1792.4 [1010.4]	856.6 [482.9]	9.2– 19960.6	1906.5
4	Cough	4	1	1473.7 [975.0]	283.1 [187.3]	5.6 – 4210.0	603.6

Legend: REE – respiratory exhalation event


Table 5. The effect of increasing the room ventilation rate on the median number of particles inhaled.

Ventilation rate (Air changes per hour)	Scenario 1	Scenario 2	Scenario 3	Scenario 4
1	57.6	55.4	547.8	213.6
2	49.7	47.7	482.9	187.3
4	38.9	37.4	388.6	149.6
6	32.0	30.7	323.9	124.1
8	27.1	26.0	277.1	105.8
10	23.5	22.6	241.6	92.1

Figures

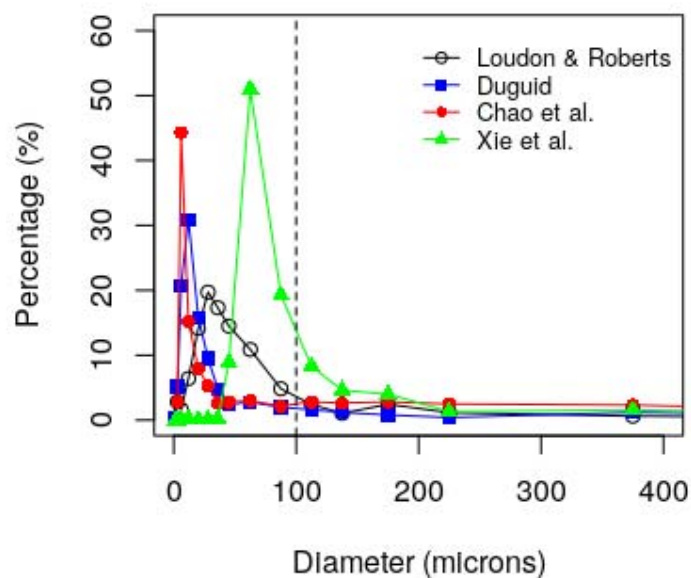


(a)

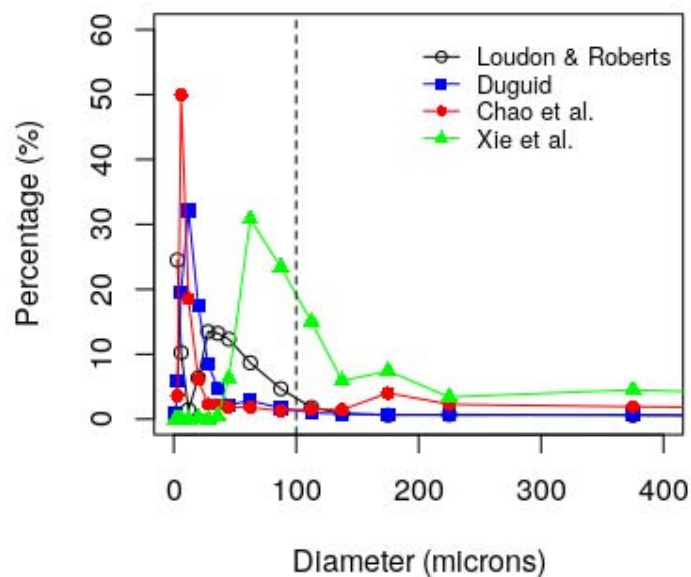


(b)

Figure 1. Distribution of number (expressed as a percentage of the total) of respiratory droplets at origin exhaled during: (a) counting from 1 to 100, and (b) a single cough, as reported by Loudon and Roberts [28], Duguid [20], Chao et al. [29], and Xie et al. [30]. The vertical dotted line indicates the 100 μm diameter cut-off threshold.

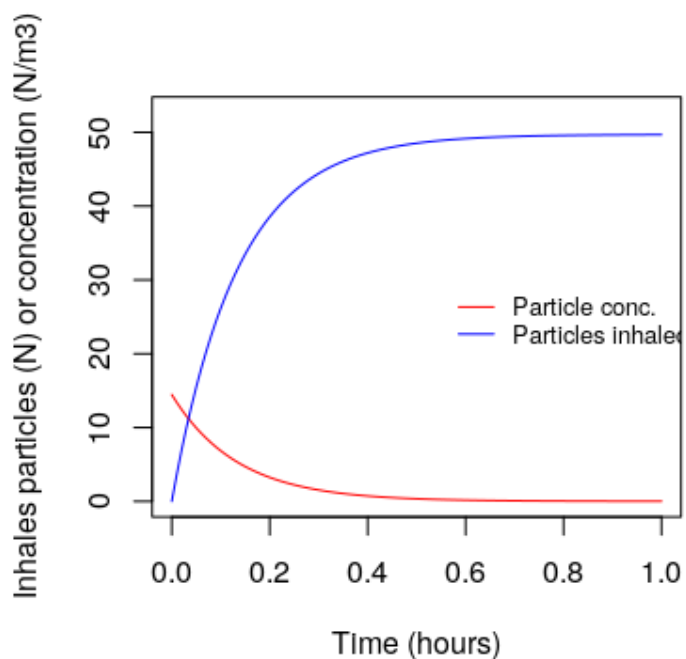


(a)

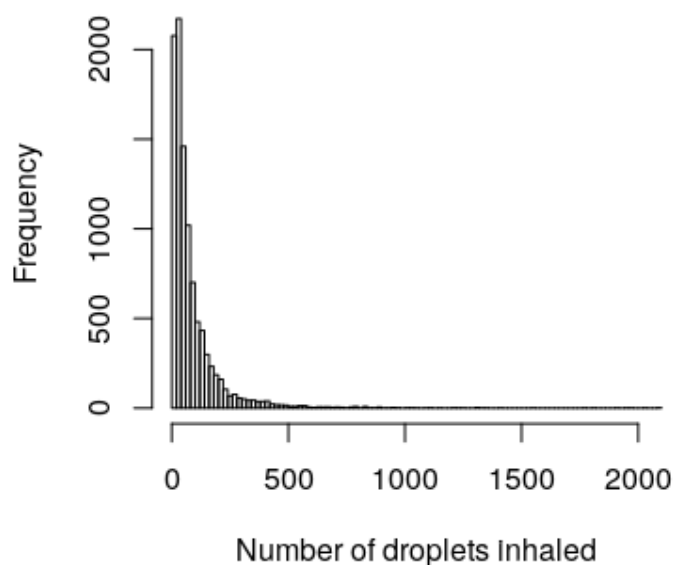


(b)

Figure 2. Results of the Scenario 1 'speaking' simulations, showing: (a) the time plot for the median number of particles inhaled and the median particle concentration in the air; and (b) the distribution of the numbers of particles inhaled, when the ventilation rate is 2 AC/h. Results are for 10,000 simulations.

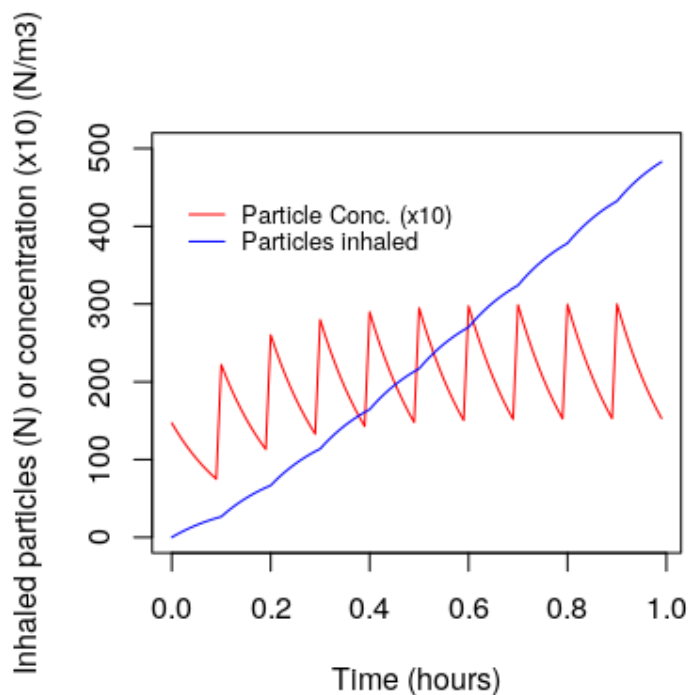


(a)

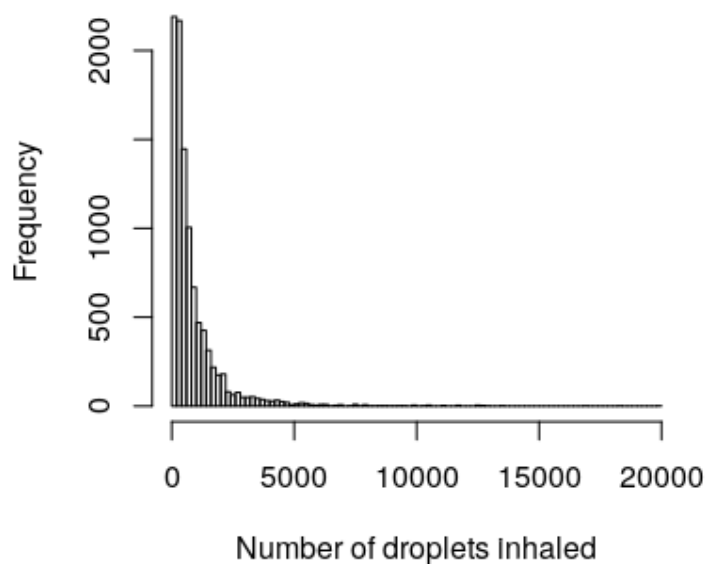


(b)

Figure 3. Results of the Scenario 3 'speaking' simulations, showing: (a) the time plot for the median number of particles inhaled and the median particle concentration (x10) in the air; and (b) the distribution of the numbers of particles inhaled, when the ventilation rate is 2 AC/h. Results are for 10,000 simulations.

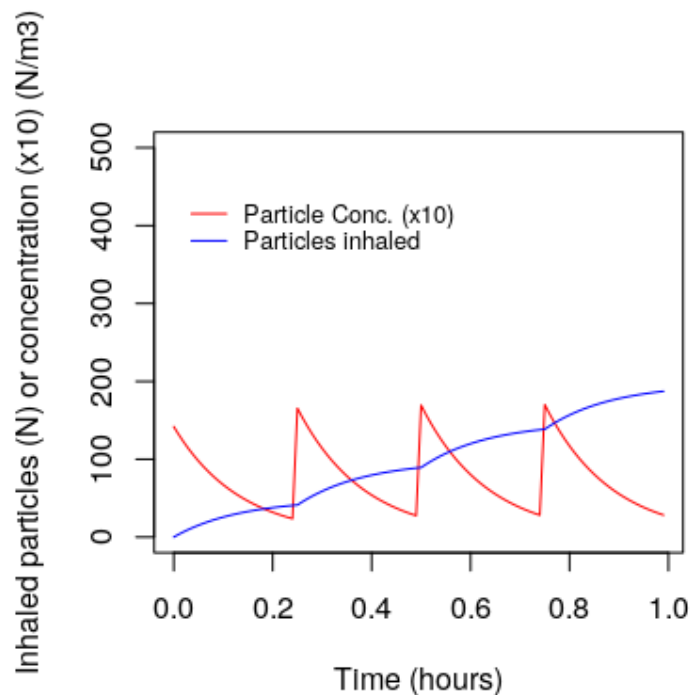

(a)

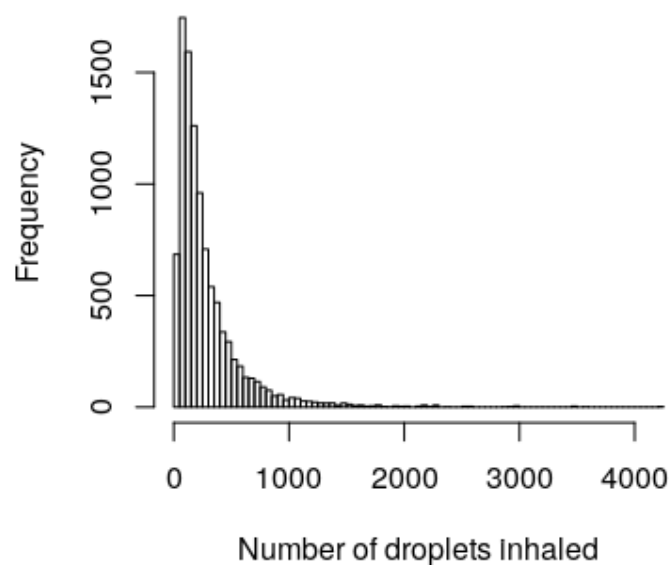

(b)

Figure 4. Results of the Scenario 4 'coughing' simulations, showing: (a) the time plot for the median number of particles inhaled and the median particle concentration (x10) in the air; and (b) the distribution of the numbers of particles inhaled, when the ventilation rate is 2 AC/h. Results are for 10,000 simulations.