

The impact of heating, ventilation, and air conditioning design features on the transmission of viruses, including the 2019 novel coronavirus: a systematic review of ultraviolet radiation

Authors:

Gail M. Thornton, PhD¹, Brian A. Fleck, PhD¹, Natalie Fleck, BA¹, Emily Krocker, MLIS¹, Dhyey Dandnayak, BSc¹, Lexuan Zhong, PhD¹, Lisa Hartling, PhD²

Affiliation:

1 Department of Mechanical Engineering, Faculty of Engineering, University of Alberta

2 Department of Pediatrics, Faculty of Medicine & Dentistry, University of Alberta

Correspondence: Dr. Brian A. Fleck; Department of Mechanical Engineering, Faculty of Engineering, University of Alberta; 116 Street and 85 Avenue; Edmonton, Alberta, Canada T6G 2R3; Email: brian.fleck@ualberta.ca

Acknowledgements: We thank Tara Landry and Alison Henry for conducting the peer review of the search strategies. We thank Samuel Ducholke, Kristen Rumbold, Larry Zhong, and Stella Mathews for their involvement in screening studies for inclusion.

Conflict of Interest: Dr. Fleck is an unpaid advisor for Pura Air Inc. in Vancouver.

Funding: This work is funded by a Canadian Institutes of Health Research (CIHR) Operating Grant: Canadian 2019 Novel Coronavirus (COVID-19) Rapid Research Funding Opportunity [https://webapps.cihr-irsc.gc.ca/decisions/p/project_details.html?applId=422567&lang=en].

Dr. Hartling is supported by a Canada Research Chair in Knowledge Synthesis and Translation.

Drs. Fleck and Zhong are supported by NSERC Discovery program.

Ultraviolet radiation and virus transmission

Abstract

Respiratory viruses are capable of transmitting via an aerosol route. Emerging evidence suggests that SARS-CoV-2 which causes COVID-19 can be spread through airborne transmission, particularly in indoor environments with poor ventilation. Heating, ventilation, and air conditioning (HVAC) systems can play a role in mitigating airborne virus transmission. We conducted a systematic review of the scientific literature examining the effectiveness of HVAC design features in reducing virus transmission—here we report results for ultraviolet (UV) radiation. Following international standards for systematic reviews, we conducted a comprehensive search and synthesized findings from 32 relevant studies published between 1936 and 2020. Research demonstrates that: viruses and bacteriophages are inactivated by UV radiation; increasing UV dose is associated with decreasing survival fraction of viruses and bacteriophages; increasing relative humidity is associated with decreasing susceptibility to UV radiation; UV dose and corresponding survival fraction are affected by airflow pattern, air changes per hour, and UV device location; and UV radiation is associated with decreased transmission in both animal and human studies. This comprehensive synthesis of the scientific evidence examining the impact of UV radiation on virus transmission can be used to guide implementation of systems to mitigate airborne spread and identify priorities for future research.

Keywords: virus, transmission, COVID-19, ultraviolet radiation, aerosol, ultraviolet germicidal irradiation (UVGI)

Ultraviolet radiation and virus transmission

Practical Implications

In-duct ultraviolet germicidal irradiation (UVGI) addresses virus transmission throughout the heating, ventilation, and air conditioning (HVAC) system of a building as a whole; whereas, upper-room UVGI addresses virus transmission in one room of that building. The susceptibility of a virus is often determined from the relationship between UV dose and survival fraction of the virus, and can be affected by relative humidity. Modelling studies revealed that practical implementation of UVGI in HVAC systems should consider airflow patterns, air changes per hour, and UV device location. Future field studies of UVGI systems could address an existing research gap and provide important information on system performance in real-world situations.

Ultraviolet radiation and virus transmission

Introduction

COVID-19, the disease caused by a coronavirus (SARS-CoV-2), was declared a pandemic by the World Health Organization in March 2020.¹ Since then, public health authorities worldwide have sought evidence about the route of transmission and appropriate public health measures to mitigate virus spread. Certain viruses have been proven capable of transmitting via an aerosol route.² In the case of aerosol transmission, virus-laden aerosols are expelled by humans and remain airborne for extended periods of time. Emerging evidence suggests that the SARS-CoV-2 virus can spread through airborne transmission under certain circumstances, particularly in indoor environments with poor ventilation.^{3,4} Selecting appropriate measures to protect the occupants of indoor spaces based on informed, interdisciplinary research is critical to managing the spread of infectious disease.⁵

Heating, ventilation, and air conditioning (HVAC) systems can play a role in mitigating the airborne transmission of viruses by removing or diluting contaminated air inside a building enclosure where humans breathe.⁵⁻⁷ Many features within HVAC systems can influence transmission, such as ventilation rates, filters, humidity, and ultraviolet (UV) radiation. Under ultraviolet germicidal irradiation (UVGI), a dose of UV light is delivered to the aerosolized virus which causes damage to the DNA impeding its ability to replicate. The ability for these cells to infect a host are therefore lost.⁸

UV radiation can be applied within mechanically ventilated spaces in the building environment through in-duct or upper-room lamp fixtures. Irradiation in an enclosed space, such as in-duct UVGI, allows for better control of the UV dose, resulting in better control of particle/pathogen exposure to UV radiation. Non-enclosed systems, such as upper-room UVGI, depend on air circulation to drive the particles/pathogens to an irradiated zone near the ceiling (designed to shield

Ultraviolet radiation and virus transmission

unwanted exposure of skin and eyes to UV radiation) as air moves through the UV zone generally due to air currents which are subject to room-scale turbulence. Importantly, in-duct UVGI addresses virus transmission throughout the building by treating the air in the HVAC system; whereas, upper-room UVGI addresses virus transmission within one room by treating the air in that room.

The use of UV radiation as a method of disinfection to help reduce the circulation and transmission of viruses has been investigated in prior research as early as the 1940s. In a narrative review of prevention and control measures of viral bioaerosols, Bing-Yuan⁷ cited several studies that collectively demonstrate the effectiveness of UV in protecting humans from transmission of airborne viruses.⁹⁻¹³ A more recent narrative review by Raeiszadeh and Adeli¹⁴ discussed the use of UV disinfection systems for both surfaces and air in the context of COVID-19, and cites one experimental study demonstrating inactivation of airborne coronaviruses by UV.¹⁵ Both of these reviews were not systematic and do not provide a comprehensive synthesis of the scientific evidence examining UV radiation.

Even as late as 2019, the American Society of Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE), in their 2019 ASHRAE Handbook,¹⁶ recognized that despite improved UVGI system design guidance from significant advances in the analysis and modelling of UVGI systems by Riley et al,¹⁷ First et al,¹⁸ Kowalski,¹⁹ and the National Institute for Occupational Safety and Health (NIOSH),²⁰ no consensus guidelines exist that exhaustively address all aspects of UVGI system design.

We conducted a systematic review to examine whether virus transmission is affected by heating, ventilation, and air conditioning (HVAC) design features, in particular, UV radiation. Our objective was to examine published research evaluating the effectiveness of UVGI in reducing

Ultraviolet radiation and virus transmission

virus transmission. The insight drawn from this review could help answer questions of the utility of UVGI as an adjunct technology to curb the spread of the SARS-CoV-2 in mechanically ventilated indoor environments. Further, understanding effectiveness relative to technology set-up and UV dose could inform control measures.

Methods

This paper describes the results of a systematic review to identify and synthesize the scientific literature examining the impact of UV radiation on virus viability and transmission within the built environment. This was part of a larger research program to review the literature on HVAC design features and airborne virus transmission. Due to the volume and heterogeneity of research, results for other design features of interest (ventilation, filtration, and humidity) are reported separately. We developed an *a priori* protocol²¹ that is publicly available and the systematic review²² is registered. We followed standards for the conduct of systematic reviews defined by the international Cochrane organization²³ with modifications for questions related to etiology.²⁴ We report the review according to accepted reporting standards.²⁵

Search strategy

A research librarian (GMT) searched three electronic databases (Ovid MEDLINE, Compendex, Web of Science Core) from inception to June 2020 using concepts related to virus, transmission, and HVAC. The search strategy for Ovid MEDLINE appears in Table 1; the strategies were peer-reviewed by two librarians (TL, AH) prior to implementing the searches. The search was updated in January 2021. We screened reference lists of all relevant papers as well as relevant review articles. We identified conference abstracts through Compendex and Web of Science; abstracts

Ultraviolet radiation and virus transmission

were not included but we searched the literature to see whether any potentially relevant abstracts had been published as complete papers. We did not limit the search by year or language of publication; however, we only included English-language studies due to the volume of available literature and resource constraints. References were managed in EndNote with duplicate records removed prior to screening.

Study selection

Study selection occurred in two stages. First, two reviewers independently screened the titles and abstracts of all references identified by the electronic databases searches. Relevance of each record was classified as Yes, No or Maybe. Conflicts between Yes/Maybe and No were resolved by one reviewer. We conducted pilot testing with three sets of studies (n=199 each) to ensure consistency among the review team. After each set of pilot screening, the review team met to discuss discrepancies and develop decision rules. The second stage involved two reviewers independently reviewing the full text articles and applying the inclusion/exclusion criteria. Studies were classified as Include or Exclude. Conflicts between Include and Exclude were resolved by consensus of the review team. Conflicts between different exclusion reasons were resolved by one reviewer. We pilot tested the second stage of screening with three sets of studies (n=30 each). After each pilot round, the review team met to resolve discrepancies. We conducted screening using Covidence software.

Inclusion and exclusion criteria

Table 2 lists our inclusion and exclusion criteria. As noted above, this systematic review was part of a larger effort to examine different HVAC design features and virus transmission. We searched and screened for all design features at once, but only studies evaluating UV radiation are synthesized here. While our interest was UV within HVAC systems, we also included studies of

Ultraviolet radiation and virus transmission

upper room UVGI because of its similar utility and mechanism of air disinfection. We searched for a variety of agents but prioritized studies of viruses or agents that simulated viruses; we planned to include other agents (e.g., bacteria, fungi) only if studies were not available that were specific to viruses. We included studies of bacteriophages, which are viruses that infect bacterial cells.¹⁹ We were interested in studies of the indoor built environment (e.g., office, public, residential buildings) which had mechanical ventilation. We included primary research that provided quantitative results of the correlation or association between installed UV radiation and virus survival or transmission. We placed no restrictions on year of publication; we included only English-language, peer-reviewed publications.

Risk of Bias assessment

For experimental studies, we assessed risk of bias based on three key domains: selection bias, information bias and confounding.²⁶⁻²⁷ We assessed each domain as high, unclear, or low risk of bias using signaling questions²⁸ from guidance documents for the different study types we included; e.g., animal studies, laboratory experiments, epidemiological studies.^{26-27,29} For modelling studies, we assessed the following three key domains: definition, assumption, and validation.²⁹⁻³⁰ Definition considers model complexity and data sources, assumption considers the description and explanation of model assumptions, and validation considered model validation and sensitivity analysis.³⁰ Also, we assessed each domain as high, unclear or low risk of bias based on signaling questions.²⁹⁻³¹ The risk of bias items were pilot tested among three review authors, then two reviewers (GMT, BAF) applied the criteria independently to each relevant study and met to resolve discrepancies.

Data extraction

Ultraviolet radiation and virus transmission

We extracted general information about the study (authors, year of publication, country of corresponding author, study design) and methods (setting, population [as applicable], agent studied, intervention set-up). We extracted details on UV treatment parameters (where available), including: wavelength; UV dose; exposure time; and fluence rate. Also, we extracted information (where available) regarding relative humidity (RH). The studies were grouped as “in-duct UVGI” and “upper-room UVGI.” We extracted quantitative data, as well as results of any tests of statistical significance related to UV features. A priori, our primary outcome of interest was quantitative measures of the association between UV radiation and virus transmission; however, during the review we realized that most studies focused on proxy variables such as virus survival. Therefore, we extracted data on actual transmission where available (i.e., infections), as well as proxy variables (e.g., survival fraction (SF), dose-response of UV dose and survival fraction, susceptibility (Z), and equivalent air changes per hour (ACH) due to UV radiation (ACH_{uv})). Survival fraction (SF) is the concentration of virus after UV exposure divided by the concentration of virus before UV exposure. UV dose (D) [J/m^2] is the fluence rate [W/m^2] multiplied by the exposure time [s]. The dose-response relationship of UV dose and survival fraction is often represented as $SF = \exp(-ZD)$, where Z is the susceptibility and $\exp()$ represents exponential function. Equivalent ACH due to UV radiation (ACH_{uv}) is the number of air changes per hour (ACH) that would produce the same reduction in virus concentration as obtained using UV radiation. We created a data extraction form spreadsheet to ensure comprehensive and consistent capture of data. One reviewer extracted data and a second reviewer verified data for accuracy and completeness. Discrepancies were discussed by the review team.

Data synthesis

Ultraviolet radiation and virus transmission

We anticipated that meta-analysis would not be possible due to heterogeneity across studies in terms of study design, UV features examined, outcomes assessed, and reporting of results. We developed evidence tables describing the studies and their results (as reported by the authors of the primary studies). We provide a narrative synthesis of the results of relevant studies. To allow for meaningful synthesis and comparison across studies, we divided the studies into four groups: aerosolized virus, modelling, animal studies, human studies. Within the aerosolized virus group, the effect of RH was further examined.

Results

The electronic searches and other sources yielded 12,177 unique citations; 2,428 were identified as potentially relevant based on title/abstract screening and 568 met the review's inclusion criteria (Figure 1). Of the 568, 125 were relevant to UV radiation and, of those 125, 32 were relevant to UV radiation and virus (Figure 1). Among the 32 relevant studies there were: 16 aerosolized virus and bacteriophage studies (Table 3), 7 modelling studies (Table 4), 4 animal studies (Table 5), and 5 human studies (Table 6). Studies were published between 1936 and 2020 (median year 2007.5). While the majority of the experimental and modelling studies were published between 2005 and 2020, with one exception in 1964, the human studies are all from the 1940s and the animal studies spanned from 1936 to 2020. The majority of studies were conducted in the United States (n=24). Studies were funded by national research funding organizations (n=13), industry (n=6), a university and state grant (n=1), and hospital (n=1); 2 studies reported no external funding and 8 studies did not report funding source.

Aerosolized virus studies

Ultraviolet radiation and virus transmission

Table 3 shows that 17 viruses and five bacteriophages from 16 studies were inactivated by UV radiation. Generally, susceptibility was determined from the dose-response relationship of UV dose and survival fraction^{11,13,15,32-34}; however, Walker and Ko¹⁰ calculated susceptibility from a single dose and corresponding survival fraction, and Lin et al³⁵ used both approaches. Some entries in Table 3 are presented as survival fraction calculated from the reported efficiency³⁶⁻³⁸ or the reported log reduction.³⁹ For Qiao et al³⁹ and Pearce-Walker et al,³⁹ a lower detection limit was used to calculate the reported efficiency and log reduction, respectively. For Verreault et al,⁴⁰ the reported relative infectious ratio appears to be equivalent to survival fraction; however, associations are presented with respect to relative infectious ratio. For 3 studies, UV radiation was associated with survival fraction.³⁷⁻³⁹

Increasing UV dose was associated with decreasing survival fraction for 10 viruses and five bacteriophages from 12 studies. Increasing UV dose was associated with decreasing survival fraction where the dose-response relationship was used to calculate susceptibility for seven studies (Table 3).^{11,13,15,32-35} Additionally, UV dose was associated with decreasing survival fraction where dose varied by exposure time,^{36,40} number of UV fixtures,¹² and fluence rate.⁴¹⁻⁴²

Increasing RH was associated with decreasing susceptibility in four studies^{11,13,32-33} for a variety of infectious agents including viruses (Influenza A, Vaccinia virus, PRRSV) and bacteriophages (MS2, phiX174, phi6, T7) (Figure 2). Cutler et al³³ reported that PRRSV susceptibility was significantly lower at $\geq 80\%RH$ compared with 25%RH-79%RH. In addition, four studies that report susceptibility at one RH are included in Figure 2^{10,15,34-35} where three viruses were coronaviruses (murine hepatitis virus (MHV) coronavirus, human coronavirus 229E, human coronavirus OC43). Considering the findings for influenza A^{13,34} and coronaviruses,^{10,15} UV radiation inactivated these enveloped, single-stranded RNA viruses and increasing UV dose was

Ultraviolet radiation and virus transmission

associated with decreasing survival fraction characterized by the susceptibility. If enveloped, single-stranded RNA animal viruses behave like influenza A (Figure 2), then increasing RH may be associated with decreasing susceptibility to UV radiation of coronavirus. The design of the UV radiation in an HVAC system should consider the reported coronavirus susceptibility recognizing that two are dose-response¹⁵ and one is single dose¹⁰ (Table 3).

Bacteriophage MS2 showed a discrepancy where Tseng and Li³² found that increasing RH was associated with decreasing susceptibility and Walker and Ko¹⁰ found that increasing RH was associated with increasing susceptibility. Walker and Ko¹⁰ acknowledged that this relationship for bacteriophages (MS2) and animal viruses (adenovirus) was different from that reported previously for bacteria. Other differences between the two studies of bacteriophage MS2 include the susceptibility calculation and suspending medium. Susceptibility was calculated using dose-response of UV dose and survival fraction by Tseng and Li³² and using a single dose and survival fraction by Walker and Ko.¹⁰ Deionized water was used by Tseng and Li³² and phosphate buffered saline with 0.01% Tween 80 and Antifoam A was used by Walker and Ko.¹⁰

Three studies examined upper-room UVGI using a room-sized chamber.^{12,41-42} McDevitt et al (2008) examined the effect of summer conditions (80% RH and fan directing air downwards) and winter conditions (40% RH and fan directing air upwards) on survival of vaccinia virus, in addition to number of fixtures and ACH for upper-room UVGI. Comparing winter and summer conditions, increasing RH and changing fan direction were associated with increasing survival fraction and decreasing equivalent ACH. Overall, increasing RH was associated with increasing survival fraction, decreasing susceptibility and decreasing equivalent ACH. These findings suggest that the design of UV radiation in an upper-room UVGI system should consider the typical variation of indoor relative humidity throughout the year.

Ultraviolet radiation and virus transmission

Modelling studies

In the experimental study by McDevitt et al¹² increasing ACH was associated with increasing survival fraction. Two modelling studies confirmed the association of increasing ACH and increasing survival fraction (Table 4).⁴³⁻⁴⁴ Increasing ACH is associated with increasing survival fraction because the increased ACH decreases the time that the infectious agent is exposed to UV radiation. Li et al⁴³ considered the removal survival fraction which was the sum of the survival fraction attributed to UV radiation and the survival fraction attributed to ventilation. Increasing ACH was associated with decreasing removal survival fraction and decreasing ventilation survival fraction despite an increasing UV radiation survival fraction. The relationship between ACH and UV radiation is an important design consideration.

Susceptibility (Z), like those calculated in the aerosolized virus studies, are important input parameters in modelling studies.⁴³⁻⁴⁵ Three modelling studies used computational fluid dynamics (CFD) models (Table 4) to investigate the association of UV device location and UV dose and/or survival fraction. Li et al⁴³ found that the survival fraction was decreased when the UV devices were located at the ceiling in the centre of the four walls compared with at the four corners. Sung and Kato⁴⁵ found that the highest UV dose and lowest survival fraction were associated with the UV device being located opposite the one exhaust. Noakes et al⁴⁷ found that UV dose was less affected by which one of the four UV devices was active when ventilated air was supplied at the floor and extracted at the ceiling compared with when ventilated air was supplied at the ceiling and extracted at the floor.

Furthermore, UV dose was associated with airflow pattern. Noakes et al⁴⁷ found a higher average UV dose in the occupied region of the room when ventilated air was supplied at the floor and extracted at the ceiling compared with when ventilated air was supplied at the ceiling and extracted

Ultraviolet radiation and virus transmission

at the floor. The modelling of upper-room UVGI confirmed that designs must consider airflow pattern,⁴⁷ ACH,⁴³⁻⁴⁴ and UV device location.^{43,45,47}

UV radiation was associated with decreased attack rate which is the number of new cases in population at risk divided by number of persons at risk in population. Zheng et al⁴⁸ found that attack rate decreased 87.8% when UVGI was modelled on a cruise ship where the ACH due to UV was 12 ACH.

Animal and human studies

As early as 1936, UV radiation was associated with decreased influenza transmission in an animal model⁴⁹ (Wells, 1936) (Table 5). UV radiation was associated with decreased virus transmission and infection incidence in three of the animal studies.⁴⁹⁻⁵¹ Dee et al⁵² acknowledged that the lack of effect was likely due to insufficient exposure time to the UV radiation (Table 5).

All of the five human studies⁵³⁻⁵⁷ were from the 1940s and investigated upper-room UVGI (Table 6). UV radiation was associated with decreased transmission of respiratory infections in three studies.^{53,55-56} In the studies of barracks, Wheeler et al⁵³ found that high intensity UV treatment was required to decrease transmission. UV radiation was associated with modified spread of transmission, but not prevention of transmission, of measles⁵⁴ and chickenpox⁵⁷ but not mumps.⁵⁷

Risk of bias

The risk of bias evaluation for the experimental studies demonstrated three scenarios (Table 7). Seventeen studies had low risk of bias for all three domains: selection bias, information bias, confounding. Seven studies had low risk of bias for selection bias and confounding but unclear risk of bias for information bias due to lack of clarity in the description of the UV radiation. Of

Ultraviolet radiation and virus transmission

these seven studies, four were aerosolized virus studies, two were animal studies, and one was a human study. One aerosolized virus study had low risk of bias for selection bias but high risk of bias for information bias and confounding due to lack of calibration of fluorescent bioaerosol count (FBC) and potential for UV radiation to affect fluorescence. Su et al⁵⁸ cite other studies where FBC and cultures provided a predictable functional relationship which could be seen as a calibration of this potentially powerful and useful measurement tool; however, they do not provide such a relationship. Their FBC and culture data are not compared in a way that readers can clearly see how an FBC measure predicts a concentration of a pathogen in question. Su et al^{58(p8)} recognize that “[t]here is no available research about how UV light affects bioaerosols that generate a fluorescence signal.” The risk of bias evaluation for the seven modelling studies resulted in low risk of bias for all three domains (Table 8): definition, assumption, validation.

Discussion

UV inactivation of airborne viruses is governed by the UV dose. The required dose varies depending on the type of virus, capsid structures, and host cell repair mechanisms⁵⁹. Tseng and Li³² found that dsRNA and dsDNA viruses required a dose that was 2 times higher than their single strand counterparts for 90% inactivation. Walker and Ko¹⁰ came to a similar conclusion when they found that adenovirus was more resistant to inactivation compared to SARS. This resistance is attributed to the double stranded nature of its DNA genome and its ability to shield or consume UV radiation using small proteins concentrated along with viral particles⁵⁹.

External factors such as ventilation and relative humidity also play an important role in UV effectiveness. Relative humidity is uniquely intertwined with UV inactivation. Many studies in this systematic review indicate that relative humidity has a marked, sometimes statistically

Ultraviolet radiation and virus transmission

significant effect on UV inactivation^{10-13,33}. Further research must be done to ascertain the interaction of relative humidity and UV inactivation in a real-world context with a diverse list of infectious agents. The effect of ventilation on UV effectiveness is similarly complex. Increasing ventilation rate and UVGI are inversely related. At a higher ventilation rate infectious agents are removed from the space at a faster pace. This results in shorter exposure times thereby decreasing the effectiveness of the UVGI system⁴¹. Dee et al⁵² stated that in their experiments UVC provided no reduction in aerosol transmission of PRRSV due to insufficient exposure time. McDevitt et al¹² argued that the combination of increased ventilation and upper room UVC is “more than merely additive”. The overall effect of a higher ventilation rate results in an increase in the ACH_{uv} (effective ventilation due to UVC). Li et al⁴³ came to a similar conclusion that while UV disinfection efficiency decreases when ventilation rate increases, the overall infectious agent removal rate increases. In addition to ventilation rates, airflow patterns can have a meaningful impact on UVGI effectiveness⁴⁷. Well mixed air allows UVGI to be more effective^{12,41,47}. UVGI systems should be designed specifically for the targeted space. Ventilation rate, airflow patterns, and relative humidity should all be taken into consideration. In spaces with no ventilation systems or where increasing the ventilation rate would not be feasible, UVGI can provide cost effective air disinfection⁶⁰. Spaces with a low outdoor air fraction can also benefit by adopting UVGI⁵⁰. When considering upper room UVGI, lamp placement can have a significant impact on the effectiveness of the inactivation⁴⁷. UV devices set on a wall rather than the corners of the room improves the effectiveness of the UVGI system⁴³. Building owners and operators should consult an expert when examining the feasibility of installing UVGI in their space. First et al^{41(p328)} states that “upper-room UVGI must be approached as a carefully interdependent system with critical interactions among luminaire selection, luminaire placement, and all aspects of a ventilation system.”

Ultraviolet radiation and virus transmission

When investigating the effectiveness of UVGI it is important to carefully consider the viral challenge and ensure the experiment mimics natural conditions. Even though Jensen^{36(p420)} used viral aerosol concentrations that were “many times greater than one would normally expect to encounter under natural conditions”, they stated that UVGI used in conjunction with filtration “should kill virtually all viruses”. Walker and Ko¹⁰ discussed the importance of aerosolization, sampling, and medium. Some viruses might be inactivated in the act of aerosolization or sampling; a medium with a high protein concentration might protect the targeted virus from inactivation¹⁰. UV susceptibility in liquid suspensions cannot be substituted for susceptibility in aerosols. Walker and Ko¹⁰ found that for the viruses they tested, UV susceptibility was higher in aerosols than in liquid suspensions. Attenuated strains of infectious agents can be used as a safer alternative to the actual virus as they are expected to closely mimic the behaviour of the actual viruses compared to an alternative surrogate³⁹. With regards to safety, Welch et al³⁴ and Buonanno et al¹⁵ have proposed the use of far UVC (222 nm) as a safer alternative to conventional UVGI (254 nm). It was demonstrated that far UVC has a similar inactivation efficiency to conventional UVGI for aerosolized coronavirus while not appearing to be cytotoxic to human cells and tissues *in vitro* or *in vivo*^{15,61}.

Airborne transmission of respiratory pathogens is a serious issue. Like improving filtration and increasing ventilation, UVGI is a passive mitigation measure that can have an important impact on virus transmission. No responsibility is placed on the individuals in the space. Langmuir et al⁵⁶ suggests that upper room UVGI by itself is not an adequate method of air disinfection. A well designed UVGI system should work in conjunction with other mitigation measures such as adequate filtration and ventilation^{36,43,44,47,51}. Perkins⁵⁴ and Bahlke⁵⁷ found that even in the event of an outbreak, the use of UVGI led to low grade protracted epidemics of measles and chickenpox

Ultraviolet radiation and virus transmission

respectively, as opposed to large explosive episodes. The effectiveness of UVGI has been known for a long time. The benefits of a well designed UVGI system outweigh the principal and maintenance costs⁵⁵. The time has come for UVGI to be considered as essential as ventilation and filtration.

The results of this systematic review revealed several important findings. First, viruses and bacteriophages were inactivated by UV radiation. Second, increasing UV dose was associated with decreasing survival fraction of viruses and bacteriophages. Third, increasing relative humidity was associated with decreasing susceptibility to UV radiation. Fourth, UV dose and corresponding survival fraction were affected by airflow pattern, ACH, and UV device location. Finally, UV radiation was associated with decreased transmission in both animal and human studies. While some of these findings may be well-established in the UV / technical literature, the value of this review is in bringing together this information in a comprehensive and rigorous manner to inform practical applications and set-up of UV systems in the built environment to assist with infection control. Further, we have identified gaps in the scientific literature that warrant attention to advance this important field.

Studies characterized as in-duct UVGI are designed with mechanically induced air flow with a controlled mean velocity which transports air through an irradiated zone inside a duct. In-duct UVGI lends itself to greater experimental control of the UV dose than the upper-room UVGI, although laminar duct flow, non-uniform velocity profiles, and radiation distribution always lead to some dose variance for in-duct systems. Also, in-duct configurations tend to simulate practical conditions where UVGI is installed in HVAC systems or air purifiers. Non-enclosed systems like upper-room UVGI depend on air circulation to drive the particles to an irradiated zone near the ceiling and does not require a controlled mean velocity: air moves through the UV zone generally

Ultraviolet radiation and virus transmission

due to air currents which are subject to room-scale turbulence. Thus their evaluation becomes more complex, needing to take into account ventilation configurations, air currents and lamp installation locations.

Two main thrusts of the research emerged: (1) research that focused on the effect of UV radiation on aerosolized virus survival and (2) research that considered some or all of the transmission chain from infected host to aerosolized virus to infected target where specific UV radiation configurations or scenarios were evaluated.

Implications for research

Future research must ensure that UV dose and UV design requirements are clearly described within the context of their own study in order to simplify comparison between studies. A common metric used for quantifying the effects of UV on airborne pathogens was the measure of the survival fraction, comparing a quantity before and after the UV intervention. This metric is easy to understand but is highly dependent on the configuration of the system for exposing the aerosol to UV radiation. It shows how a system in its entirety kills or inactivates the pathogen in question, but does not isolate the more fundamental dose-response as the susceptibility (Z) measure, which is the exponent or linear slope on a semi-log Cartesian plot of the UV dose versus survival fraction. An encouraging and important trend evident in this body of work is the general evolution toward more rigorous control of experimental conditions which lend themselves to clear quantification of dose-response. Knowing that not all UV sources are alike, and that flux divergence, reflection, air velocity profile and lack of turbulence can lead to non-uniform UV radiation of aerosols allows researchers to focus on comparing susceptibility (Z) values, a single parameter. In some cases, the UV radiation and aerosolized virus studies were able to provide the mechanistic quantitative

Ultraviolet radiation and virus transmission

measure of susceptibility (Z) which is useful for cross study comparisons and is an important input parameter in modelling studies.

In addition to research examining the effect of UV radiation on aerosolized virus survival, the other main focus was research considering some or all of the transmission chain from infected host to aerosolized virus to infected target under specific UV radiation conditions. These results tend to be somewhat anecdotal because there is no standard test for the full transmission chain between two or more people sharing breathing space in the built environment. This is a common challenge in many fields of research. There would be value if the community moved to a more standardized test case configuration such as a standard room and ventilation system configuration, so that discrepancies attributable to factors such as geometry and flow field could be eliminated. The ASHRAE 185.1 standard states “Test standards form the foundation for air-cleaner selection in the ventilation industry. U.S. Environmental Protection Agency (USEPA) literature states that the most important need in the area of ultraviolet germicidal irradiation (UVGI) is industry standards to rate installed devices.”^{62(p2)}

All human studies of upper-room UVGI that we identified were field studies conducted between 1945-1949. In a historical review, Reed⁶³ indicates that UVGI fell out of favour after the 1940s due to inconsistent UV effects on measles transmission in schools, which were later attributed to measles exposure outside of schools. Additionally, no human studies on virus transmission and UV radiation were found after the 1940s which is a time period before vaccinations for measles,⁶⁴ chickenpox,⁶⁵ and mumps.⁶⁶ Reed⁶³ attributes more recent attention on UVGI to bacteria, tuberculosis, and viruses, influenza and SARS. In the current review, recent studies of UVGI are modelling studies in hospital settings from 2006 to 2020 in which influenza (2011) and coronavirus

Ultraviolet radiation and virus transmission

(2020) were considered. More field studies of upper-room UVGI are warranted to advance our understanding of its applicability.

Implications for practice

The design of the UVGI for implementation in a building environment, whether in-duct or upper-room, should consider which virus is targeted. An additional consideration is how the susceptibility of that virus is affected by changes in relative humidity (Figure 2). If more than one infectious agent is targeted, then a range of susceptibilities should be considered. Jaynes et al⁵¹ designed their UVGI system to target one bacteria and two viruses (Table 5). Practical application of UVGI systems should take into account lessons learned from modelling studies; i.e. UV dose produced by the UV system may be affected by the airflow pattern, ACH and UV device location.^{43-45,47}

Generally, in-duct UVGI can be used to prevent in-building transmission when ventilation supply air has some fraction which is recycled, a practice which is a common means to reduce heating/cooling costs. Also, in-duct UVGI could be incorporated into a ducted air purification system which exhausts back into the source space directly and might be a tool used to remove airborne virus in a space at a rate higher than could be achieved by the building air handling system alone. In both of these cases the survival of pathogen after UV exposure would need to be extremely low for them to be effective (though in practice in-duct systems would generally operate in series with aerosol removal by filtration). A consensus on an acceptable standard for virus reduction due to UV treatment might be helpful. Experimental studies may benefit from using the ASHRAE Standard 52.2 test duct which has been used in recent filtration studies.⁶⁷⁻⁶⁸ Simply seeing more studies recognize that UV radiation dose is dependent on the radiant flux, which is often not uniform, shows a positive trend. For ducted systems, flow that is well-mixed and close to uniform in velocity profile is helpful in evenly dosing aerosols with UV.

Ultraviolet radiation and virus transmission

Upper-room UVGI is specifically designed to reduce the buildup of pathogen in the shared breathing space of occupants and in this technology there is definitely no standard for what is an acceptable performance for these systems. As was done by First et al,⁴¹ Rudnick and First,⁴² and McDevitt et al,¹² the equivalent ACH does seem to be a sensible way to calibrate these systems.

Two experimental studies^{15,34} and one modelling study⁴⁴ investigated the effects of far-UVC light (222 nm) on virus survival as an alternative to conventional UVC light sources. Viruses used included human coronaviruses alpha HCoV-229E and beta HCoV-OC43,¹⁵ SARS-CoV-2,⁴⁴ and Influenza A (H1N1).³⁴ While conventional UV has been shown to reduce virus survival fractions, conventional UV can be carcinogenic and cataractogenic^{34,44} and a health hazard when exposed directly.¹⁵ Far-UVC light has been posited as an option for UV radiation as, since far-UVC light has a lower range “of less than a few micrometers, and thus it cannot reach living human cells in the skin or eyes,” the range is still greater than that of viruses, allowing UVC light to “penetrate and kill them.”^{15(p1)} Given concerns of ozone generating by 185nm UV, Welch et al³⁴ measured O₃ concentration and could not detect ozone with their 5ppb threshold of detection.

Conclusion

This review provides a comprehensive and rigorous synthesis of the existing scientific literature examining the effectiveness of UV radiation and virus survival and transmission. Experimental studies of UV radiation have consistently demonstrated high susceptibility of viruses (or simulant agents) with sufficient UV dose. At this time, the UV susceptibility of aerosolized SARS-CoV-2 has yet to be reported. However, there are few studies examining the effect of UV radiation outside laboratory or simulated settings. Further, future field studies of real-world implementations of

Ultraviolet radiation and virus transmission

UVGI need to take into account the various factors that exist within ventilated indoor spaces that may modify UV effectiveness, including humidity, airflow pattern, air changes per hour, and UV device location. Research is needed to provide evidence of the effect of UV radiation along the chain of transmission in non-simulated “real life” settings.

Ultraviolet radiation and virus transmission

References

1. World Health Organization (WHO). WHO Director-General's opening remarks at the media briefing on COVID-19 - 11 March 2020. <https://www.who.int/director-general/speeches/detail/who-director-general-s-opening-remarks-at-the-media-briefing-on-covid-19---11-march-2020>. Accessed 4 April 2021.
2. Leung NHL. Transmissibility and transmission of respiratory viruses. *Nat Rev Microbiol.* 2021. doi:10.1038/s41579-021-00535-6
3. Noorimotlagh Z, Jaafarzadeh N, Martinez SS, Mirzaee SA. A systematic review of possible airborne transmission of the COVID-19 virus (SARS-CoV-2) in the indoor air environment. *Environ Res.* 2021;193:110612. doi:10.1016/j.envres.2020.110612
4. Rahimi NR, Fouladi-Fard R, Aali R, Shahryari A, Rezaali M, Ghafouri Y, Ghalhari MR, Asaadi-Ghalhari M, Farzinnia B, Gea OC, Fiore M. Bidirectional association between COVID-19 and the environment: a systematic review. *Environ Res.* 2021;194:110692. doi:10.1016/j.envres.2020.110692
5. Luongo JC, Fennelly KP, Keen JA, Zhai ZJ, Jones BW, Miller SL. Role of mechanical ventilation in the airborne transmission of infectious agents in buildings. *Indoor Air.* 2016;26:666-678. doi:10.1111/ina.12267
6. Li Y, Leung GM, Tang JW, Yang X, Chao CYH, Lin JZ, Lu JW, Nielsen PV, Niu J, Qian H, Sleigh AC, Su H-JJ, Sundell J, Wong TW, Yuen PL. Role of ventilation in airborne transmission of infectious agents in the build environment – a multidisciplinary systematic review. *Indoor Air.* 2007;17:2-18. doi:10.1111/j.1600-0668.2006.00445.x
7. Bing-Yuan, Zhang Y-H, Leung NHL, Cowling BJ, Yang Z-F. Role of viral bioaerosols in nosocomial infections and measures for prevention and control. *J Aerosol Sci.* 2018;117:200-211. doi:10.1016/j.jaerosci.2017.11.011
8. Brickner PW, Vincent RL, First M, Nardell E, Murray M, Kaufman W. The Application of Ultraviolet Germicidal Irradiation to Control Transmission of Airborne Disease: Bioterrorism Countermeasure. *Public Health Rep.* 2003;118(2):99-114.
9. Scarpino, P. V., Jensen, N. J., Jensen, P. A., & Ward, R. (1998). The use of ultraviolet germicidal irradiation (UVGI) in disinfection of airborne bacteria and rhino-viruses. *J Aerosol Sci.* 29(Suppl.1):S777–S778.
10. Walker CM, Ko G. Effect of ultraviolet germicidal irradiation on viral aerosols. *Environmental Sci Technol.* 2007;41(15):5460-5465. doi:10.1016/j.jpdpdt.2020.101943
11. McDevitt JJ, Lai KM, Rudnick SN, Houseman EA, First MW, Milton DK. Characterization of UVC light sensitivity of vaccinia virus. *Appl Environ Microbiol.* 2007;73(18):5760-5766. doi:10.1128/AEM.00110-07
12. McDevitt JJ, Milton DK, Rudnick SN, First MW. Inactivation of Poxviruses by Upper-Room UVC Light in a Simulated Hospital Room Environment. *PLoS ONE.* 2008;3(9):1-7. doi:10.1371/journal.pone.0003186
13. McDevitt JJ, Rudnick SN, Radonovich LJ. Aerosol susceptibility of influenza virus to UV-C light. *Appl Environ Microbiol.* 2012;78(6):1666-1669. doi:10.1128/AEM.06960-11
14. Raeiszadeh M, Adeli B. A Critical Review on Ultraviolet Disinfection Systems against COVID-19 Outbreak: Applicability, Validation, and Safety Considerations. *ACS Photonics.* 2020;7(11):2941-2951. doi:10.1021/acsp Photonics.0c01245

Ultraviolet radiation and virus transmission

15. Buonanno M, Welch D, Shuryak I, Brenner DJ. Far-UVC light (222 nm) efficiently and safely inactivates airborne human coronaviruses. *Sci Rep*. 2020;10(1):1-8. doi:10.1038/s41598-020-67221-2
16. ASHRAE. Chapter 62. Ultraviolet Air and Surface Treatment. In: *2019 ASHRAE Handbook: HVAC Applications*. Atlanta: American Society of Heating, Refrigerating and Air-Conditioning Engineers; 2019.
17. Riley RL, Knight M, Middlebrook G. Ultraviolet susceptibility of BCG and virulent tubercle bacilli. *Am Rev Respir Dis*. 1976;113(4):413-418.
18. First MW, Nardell EA, Chaisson W, Riley R. Guidelines for the Application of Upper-Room Germicidal Irradiation for preventing Transmission of Airborne Contagion - Part I: Basic Principles. *ASHRAE Trans*. 1999;105:869-876.
19. Kowalski, WJ. *Ultraviolet germicidal irradiation handbook: UVGI for air and surface disinfection*. Heidelberg: Springer-Verlag; 2009.
20. National Institute for Occupational Safety and Health (NIOSH). *Environmental control for tuberculosis: Basic upper-room ultraviolet germicidal irradiation guidelines for healthcare settings*. March 2009. NIOSH Publication 2009-105. <https://www.cdc.gov/niosh/docs/2009-105/> Accessed April 12, 2021
21. Thornton GM, Fleck BA, Zhong L, Hartling L. The impact of heating, ventilation and air conditioning (HVAC) design features on the transmission of viruses, including the 2019 novel coronavirus (COVID-19): protocol for a systematic review and environmental scan. *Open Science Framework*. 2020. <https://doi.org/10.17605/OSF.IO/Y62V7>
22. Thornton G, Zhong L, Fleck B, Hartling L. The impact of heating, ventilation and air conditioning (HVAC) design features on the transmission of viruses, including the 2019 novel coronavirus (COVID-19): a systematic review. PROSPERO. 08 July 2020. https://www.crd.york.ac.uk/prospéro/display_record.php?ID=CRD42020193968 Accessed July 8, 2020
23. Higgins JPT, Thomas J, Chandler J, Cumpston M, Li T, Page MJ, Welch VA. *Cochrane handbook for systematic reviews of interventions version 6.0*. Updated July 2019. Cochrane. Available from www.training.cochrane.org/handbook.
24. Moola S, Munn Z, Sears K, et al. Conducting systematic reviews of association (etiology): The Joanna Briggs Institute's approach. *Int J Evid Based Healthc*. 2015;13(3):163-169. doi:10.1097/XEB.0000000000000064
25. Moher D, Liberati A, Tetzlaff J, Altman D G. Preferred reporting items for systematic reviews and meta-analyses: the PRISMA statement. *BMJ*. 2009;339:b2535. doi:10.1136/bmj.b2535
26. Williams-Nguyen J, Bueno I, Sargeant JM, Nault AJ, Singer RS. What is the evidence that point sources of anthropogenic effluent increase antibiotic resistance in the environment? Protocol for a systematic review. *Anim Health Res Rev*. 2016;17(1):9-15. doi:10.1017/S1466252316000037
27. Office of Health Assessment and Translation (OHAT), Division of the National Toxicology Program, National Institute of Environment Health Sciences. *Handbook for conducting a literature-based health assessment using OHAT approach for systematic review and evidence integration*. National Toxicology Program, US Department of Health and Human Services, 4

Ultraviolet radiation and virus transmission

- March 2019. https://ntp.niehs.nih.gov/ntp/ohat/pubs/handbookmarch2019_508.pdf Accessed November 28, 2020.
28. Higgins JPT, Thomas J, Chandler J, Cumpston M, Li T, Page MJ, Welch VA (editors). *Cochrane Handbook for Systematic Reviews of Interventions version 6.2*. Updated February 2021. Cochrane. Available from www.training.cochrane.org/handbook
 29. Samuel GO, Hoffmann S, Wright RA, et al. Guidance on assessing the methodological and reporting quality of toxicologically relevant studies: A scoping review. *Environ Int*. 2016;92-93:630-646. doi:10.1016/j.envint.2016.03.010
 30. Mateus ALP, Otete HE, Beck CR, Dolan GP, Nguyen-Van-Tam JS. Effectiveness of travel restrictions in the rapid containment of human influenza: a systematic review. *Bull World Health Organ*. 2014;92(12):868-880D. doi:10.2471/BLT.14.135590
 31. Organisation for Economic Co-operation and Development (OECD). *Guidance Document on the Validation of (Quantitative) Structure-Activity Relationship [(Q)SAR] Models*. OECD Series on Testing and Assessment No. 69, OECD Publishing, 3 September 2014. <https://doi.org/10.1787/9789264085442-en>. Accessed January 4, 2021.
 32. Tseng CC, Li CS. Inactivation of virus-containing aerosols by ultraviolet germicidal irradiation. *Aerosol Sci Technol*. 2005;39(12):1136-1142. doi:10.1080/02786820500428575
 33. Cutler TD, Wang C, Hoff SJ, Zimmerman JJ. Effect of temperature and relative humidity on ultraviolet (UV254) inactivation of airborne porcine respiratory and reproductive syndrome virus. *Vet Microbiol*. 2012;159(1-2):47-52. doi:10.1016/j.vetmic.2012.03.044
 34. Welch D, Buonanno M, Grilj V, et al. Far-UVC light: A new tool to control the spread of airborne-mediated microbial diseases. *Sci Rep*. 2018;8(1):1-7. doi:10.1038/s41598-018-21058-w
 35. Lin WE, Guo Q, Savory E, Mubareka S, Steinhoff A, Scott JA. Pulsed ultraviolet light decontamination of virus-laden airstreams. *Aerosol Sci Technol*. 2017;51(5):554-564. doi:10.1080/02786826.2017.1280128
 36. Jensen MM. Inactivation of Airborne Viruses by Ultraviolet Irradiation. *Appl Microbiol*. 1964;12:418-420. doi:10.1128/aem.12.5.418-420.1964
 37. Terrier O, Essere B, Yver M, et al. Cold oxygen plasma technology efficiency against different airborne respiratory viruses. *J Clin Virol*. 2009;45(2):119-124. doi:10.1016/j.jcy.2009.03.017
 38. Qiao Y, Yang M, Marabella IA, et al. Greater than 3-Log reduction in viable coronavirus aerosol concentration in ducted ultraviolet-c (UV-C) systems. *Environ Sci Technol*. 2020. doi:10.1021/acs.est.0c05763
 39. Pearce-Walker JJ, Troup DJ, Ives R, et al. Investigation of the effects of an ultraviolet germicidal irradiation system on concentrations of aerosolized surrogates for common veterinary pathogens. *Am J Vet Res*. 2020;81(6):506-513. doi:10.2460/ajvr.81.6.506
 40. Verreault D, Marcoux-Voiselle M, Turgeon N, Moineau S, Duchaine C. Resistance of aerosolized bacterial viruses to relative humidity and temperature. *Appl Environ Microbiol*. 2015;81(20):7305-7311. doi:10.1128/AEM.02484-15
 41. First M, Rudnick SN, Banahan KF, Vincent RL, Brickner PW. Fundamental factors affecting upper-room ultraviolet germicidal irradiation – part I. Experimental. *J Occup Environ Hyg*. 2007;4(5):321-331. doi:10.1080/15459620701271693

Ultraviolet radiation and virus transmission

42. Rudnick SN, First MW. Fundamental factors affecting upper-room ultraviolet germicidal irradiation – part II. Predicting effectiveness. *J Occup Environ Hyg*. 2007;4(5):352-362. doi:10.1080/15459620701298167
43. Li C, Deng B, Kim CN. Simulations to determine the disinfection efficiency of supplementary UV light devices in a ventilated hospital isolation room. *Indoor Built Environ*. 2010;19(1):48-56. doi:10.1177/1420326X09358019
44. Buchan AG, Yang L, Atkinson KD. Predicting airborne coronavirus inactivation by far-UVC in populated rooms using a high-fidelity coupled radiation-CFD model. *Sci Rep*. 2020;10(1):1-7. doi:10.1038/s41598-020-76597-y
45. Sung M, Kato S. Estimating the germicidal effect of upper-room UVGI system on exhaled air of patients based on ventilation efficiency. *Build Environ*. 2011;46(11):2326-2332. doi:10.1016/j.buildenv.2011.05.015
46. Firrantello J, Bahnfleth W. Field measurement and modeling of UVC cooling coil irradiation for heating, ventilating, and air conditioning energy use reduction (RP-1738)-Part 2: Energy, indoor air quality, and economic modeling. *Sci Technol Built Environ*. 2018;24(6):600-611. doi:10.1080/23744731.2017.1383821
47. Noakes CJ, Sleight PA, Fletcher LA, Beggs CB. Use of CFD modelling to optimize the design of upper-room UVGI disinfection systems for ventilated rooms. *Indoor Built Environ*. 15(4):347-356. doi:10.1177/1420326X06067353
48. Zheng L, Chen Q, Xu J, Wu F. Evaluation of intervention measures for respiratory disease transmission on cruise ships. *Indoor Built Environ*. 2016;25(8):1267-1278. doi:10.1177/1420326X15600041
49. Wells WF, Brown HW. Recovery of influenza virus suspended in air and its destruction by ultraviolet radiation. *Am J Epidemiol*. 1936;24(2):407-413. doi:10.1093/oxfordjournals.aje.a118273
50. Jakab GJ, Knight ME. Decreased influenza virus pathogenesis by infection with germicidal UV-irradiated airborne virus. *Environ Int*. 1982;8(1):415-418. doi:10.1016/0160-4120(82)90059-9
51. Jaynes RA, Thompson MC, Kennedy MA. Effect of ultraviolet germicidal irradiation of the air on the incidence of upper respiratory tract infections in kittens in a nursery. *J Am Vet Med Assoc*. 2020;257(9):929-932. doi:10.2460/javma.257.9.929
52. Dee SA, Batista L, Deen J, Pijoan C. Evaluation of systems for reducing the transmission of Porcine reproductive and respiratory syndrome by aerosol. *Can J Vet Res*. 2006;70(1):28-33.
53. Wheeler SM. Ultra-violet light control of air-borne infections in a naval training center. *Am J Public Health*. 1945;35:457-468. doi:10.2105/AJPH.35.5.457
54. Perkins JR. Effects of ultra-violet irradiation of classrooms on spread of measles in large rural central schools. *Am J Public Health*. 1947;37:529-537. doi:10.2105/AJPH.37.5.529
55. Higgons RA, Hyde GM. Effect of ultraviolet air sterilization upon incidence of respiratory infections in a children's institution: a 6-year study. *N Y State J Med*. 1947;47(7):707-710.
56. Langmuir AD, Jarrett ET, Hollaender A. Studies of the control of acute respiratory diseases among naval recruits: III. The epidemiological pattern and the effect of ultraviolet irradiation during the winter of 1946-1947. *Am J Epidemiol*. 1948;48(2):240-251. doi:10.1093/oxfordjournals.aje.a119239

Ultraviolet radiation and virus transmission

57. Bahlke AM. Effect of ultra-violet irradiation of classrooms on spread of mumps and chickenpox in large rural central schools - A progress report. *Am J Public Health*. 1949;39:1321-1331 doi:10.2105/ajph.39.10.1321
58. Su C, Lau J, Yu F. A case study of upper-room UVGI in densely-occupied elementary classrooms by real-time fluorescent bioaerosol measurements. *Int J Environ Res Public Health*. 2017;14(1). doi:10.3390/ijerph14010051
59. Thurston-Enriquez JA, Haas CN, Jacangelo J, Riley K, Gerba CP. Inactivation of feline calicivirus and adenovirus type 40 by UV radiation. *Appl Environ Microbiol*. 2003;69(1):577-582. doi:10.1128/AEM.69.1.577-582.2003
60. Brickner PW, Vincent RL, First M, Nardell E, Murray M, Kaufman W. The application of ultraviolet germicidal irradiation to control transmission of airborne disease: bioterrorism countermeasure. *Public Health Rep*. 2003;118(2):99-114. doi:10.1093/phr/118.2.99
61. Buonanno M, Ponnaiya B, Welch D, et al. Germicidal Efficacy and Mammalian Skin Safety of 222-nm UV Light. *Radiat Res*. 2017;187(4):483-491. doi:10.1667/RR0010CC.1
62. ASHRAE. *ANSI/ASHRAE Standard 185.1-2020 Method of Testing UV-C Lights for Use in Air-Handling Units or Air Ducts to Inactivate Airborne Microorganisms*. Atlanta, GA: American Society of Heating, Refrigerating and Air-Conditioning Engineers; 2020.
63. Reed NG. The history of ultraviolet germicidal irradiation for air disinfection. *Public Health Rep*. 125(1):15-27. doi:10.1177/003335491012500105
64. Centers for Disease Control and Prevention (CDC). Measles history. Updated 5 November 2020. <https://www.cdc.gov/measles/about/history.html>. Accessed March 10, 2021.
65. Centers for Disease Control and Prevention (CDC). Chickenpox vaccination: What everyone should know. Updated 7 August 2019. <https://www.cdc.gov/vaccines/vpd/varicella/public/index.html>. Accessed March 10, 2021.
66. Centers for Disease Control and Prevention (CDC). Mumps vaccination. Updated 8 March 2021. <https://www.cdc.gov/mumps/vaccination.html>. Accessed March 10, 2021.
67. Zhang J, Huntley D, Fox A, Gerhardt B, Vatine A, Cherne J. Study of viral filtration performance of residential HVAC filters. *ASHRAE J*. 2020;1-6.
68. Vyskocil JM, Létourneau V, St-Germain MW, Turgeon JG, Duchaine C. Challenge of mechanical and antimicrobial filters against infectious phages artificially agglomerated with inorganic dust with a known particle-size distribution. *Aerosol Sci Technol*. 2021;55(2):194-204. doi:10.1080/02786826.2020.1834073

Ultraviolet radiation and virus transmission

Table 1: Search Strategy for Ovid MEDLINE²¹

Database: Ovid MEDLINE(R) ALL 1946 to Present

Search Strategy:

#	Searches
1	exp Aerosols/
2	Air Microbiology/
3	exp Viruses/
4	(aerosol or aerosols or bioaerosol or bioaerosols).mp.
5	droplet nuclei.mp.
6	infectio*.mp.
7	(pathogen or pathogens).mp.
8	(virus or viruses or viral or virome).mp.
9	or/1-8 [MeSH + Keywords – Virus concept]
10	Air Conditioning/
11	Air Filters/ or Filtration/
12	Humidity/
13	Ventilation/
14	Ultraviolet Rays/
15	air condition*.mp.
16	(air change rate or air change rates or air changes per hour or air exchange rate or air exchange rates or air exchanges per hour).mp.
17	(airflow or air flow).mp.
18	built environment.mp.
19	computational fluid dynamics.mp.
20	((distance adj6 index) or long distances).mp.
21	HVAC.mp.
22	(filter or filters or filtration).mp.
23	humidity.mp.
24	(ultraviolet or UV).mp.
25	ventilat*.mp.
26	or/10-25 [MeSH + Keywords – HVAC concept]
27	Air Pollution, Indoor/
28	exp Disease Transmission, Infectious/
29	(indoor adj1 (air quality or environment*)).mp.
30	transmission.mp.
31	or/27-30 [MeSH + Keywords – Transmission concept]
32	9 and 26 and 31
33	remove duplicates from 32

MeSH = Medical Subject Headings

Ultraviolet radiation and virus transmission

Table 2. Inclusion and exclusion criteria for systematic review²¹

Item	Inclusion criteria	Exclusion criteria
Agent	<ul style="list-style-type: none"> • Viruses • Aerosols • Bioaerosols • Droplet nuclei • Other pathogens (e.g., bacteria, fungi) <p><i>We planned a staged process: if we identified studies specific to viruses for each HVAC design feature, we would not include other pathogens; however, for design features where we did not find studies specific to viruses, we would expand to other pathogens.</i></p>	
HVAC	Design features relating to: <ul style="list-style-type: none"> • Ventilation (ventilation rate, air changes per hour (ACH), air exchange, airflow pattern, pressurization) • Filtration (air filtration, filter type, MERV rating, filter age and/or use, pressure drop, holding capacity, replacement, change frequency) • Ultraviolet germicidal irradiation (UVGI; power, dose, uniformity of dose, flow rate, bioaerosol inactivation efficiency, location) • Humidity or relative humidity 	Examines HVAC / mechanical / or other ventilation mechanisms overall, but not by specific design features.
Setting	<ul style="list-style-type: none"> • Office buildings • Public buildings (e.g., schools, day cares) • Residential buildings • Hospitals and other healthcare facilities (e.g., clinics) • Transport vehicles (e.g., aircraft) or hubs (e.g., airports) 	<ul style="list-style-type: none"> • Outdoor settings • Indoor settings with natural ventilation
Outcomes	Quantitative data evaluating the correlation or association between virus transmission and above HVAC features	Qualitative data
Study design	Primary research, including: <ul style="list-style-type: none"> • Epidemiological studies • Observational studies (e.g., cohort, case-control, cross-sectional) • Experimental studies (including human or animal) • Modelling studies, including CFD 	<ul style="list-style-type: none"> • Review articles • Commentaries, opinion pieces • Qualitative studies
Language	English <p><i>We planned a staged process where we would include studies in languages other than English if we do not identify English language studies for specific HVAC design features or if we identified clusters of potentially relevant studies in another language.</i></p>	
Year	No restrictions	
Publication status	Published, peer-reviewed	Unpublished, not peer-reviewed

CFD = computational fluid dynamics; HVAC = heating, ventilation, and air conditioning; MERV = minimum efficiency reporting value; UVGI = ultraviolet germicidal irradiation

Ultraviolet radiation and virus transmission

Table 3. Summary of characteristics and findings for aerosolized virus and bacteriophage studies of UV treatments.

Author (Year) Country	Infectious Agent	Treatment	Outcome Parameter	Data	Association
Jensen (1964) ³⁶ USA	Influenza A (WSN) Vaccinia virus Adenovirus (type 2) Coxsackie B1 Sindbis	Wavelength: 253.7 nm Dose: > 19.4 J/m ² Exposure time: 0.3 s, 0.6 s RH: Influenza A at 68%RH, Vaccinia virus at 65%RH, Adenovirus at 50%RH, Coxsackie B1 at 66%RH, Sindbis at 62%RH In-duct UVGI	Survival fraction (SF) from efficiency	Influenza A (at 68%RH) SF= 0.0014 at 0.3 s SF = 0.0010 at 0.6 s Vaccinia virus (at 65%RH) SF= 0.0004 at 0.3 s SF = 0.0001 at 0.6 s Adenovirus (at 50%RH) SF= 0.0869 at 0.3 s SF = 0.0312 at 0.6 s Coxsackie B1 (at 66%RH) SF= 0.0240 at 0.3 s SF = 0.0005 at 0.6 s Sindbis (at 62%RH) SF= 0.0327 at 0.3 s SF = 0.0047 at 0.6 s	- Increasing exposure time (related to increasing dose) associated with decreasing survival fraction.
Tseng (2005) ³² Taiwan	MS2 (ssRNA) [15597-B1] phiX174 (ssDNA) phi6 (dsRNA, enveloped) T7 (dsDNA)	Wavelength: 253.7 nm Dose: < 12 J/m ² (Figure 2 and 3, p.1140) RH: 55%RH; 85%RH Chamber: cylinder In-duct UVGI	Dose-response Susceptibility (Z) <i>Effect of RH</i>	MS2 (ssRNA) Z=0.81 m ² /J at 55%RH Z=0.64 m ² /J at 85%RH phiX174 (ssDNA) Z=0.71 m ² /J at 55%RH Z=0.53 m ² /J at 85%RH phi6 (dsRNA) Z=0.43 m ² /J at 55%RH Z=0.31 m ² /J at 85%RH T7 (dsDNA) Z=0.33 m ² /J at 55%RH Z=0.22 m ² /J at 85%RH -Z significantly lower at higher RH for all four bacteriophages. - ssRNA and ssDNA had increased susceptibility compared with dsRNA and dsDNA. - ssRNA and ssDNA had greater increased susceptibility with increased RH compared with dsRNA and dsDNA.	- Increasing dose associated with decreasing survival fraction. - Increasing RH associated with decreasing susceptibility.
Walker (2007) ¹⁰ USA	Murine hepatitis virus (MHV) coronavirus - enveloped	Wavelength: 254 nm Dose: 5.99 J/m ² Exposure time: 16.2 s RH: 50%RH	Survival fraction (SF) Susceptibility (Z) (Susceptibility calculated from survival fraction,	At 50%RH, SF = 0.122 ± 0.072 Z = 0.377 ± 0.119 m ² /J	- UV radiation associated with survival fraction.

Ultraviolet radiation and virus transmission

	(p.5463)	Chamber: experimental duct In-duct UVGI	not dose- response.)	- Coronavirus had increased susceptibility compared with MS2 and adenovirus.	
	MS2 [15597- B1] - not enveloped (p.5463)	Wavelength: 254 nm Dose: 26.08 J/m ² Exposure time: 16.2 s RH: 32%-50%RH, 74%-82%RH Chamber: experimental duct In-duct UVGI	Survival fraction (SF) Susceptibility (Z) (Susceptibility calculated from survival fraction, not dose- response.) <i>Effect of RH</i>	At 32%-50%RH, SF = 0.311 ± 0.029 Z = 0.038 ± 0.003 m ² /J At 74%-82%RH, SF = 0.246 ± 0.035 Z = 0.048 ± 0.005 m ² /J	- Increasing RH associated with increasing susceptibility.
	Adenovirus (serotype 2) - dsDNA (p.5463)	Wavelength: 254 nm Dose: 26.08 J/m ² Exposure time: 16.2 s RH: 27%-40%RH, 50%-55%RH, 76%-80%RH Chamber: experimental duct In-duct UVGI	Survival fraction (SF) Susceptibility (Z) (Susceptibility calculated from survival fraction, not dose- response.) <i>Effect of RH</i>	At 27%-40%RH, SF = 0.329 ± 0.023 Z = 0.038 ± 0.003 m ² /J At 50%-55%RH, SF = 0.206 ± 0.035 Z = 0.052 ± 0.004 m ² /J At 76%-80%RH, SF = 0.136 ± 0.005 Z = 0.068 ± 0.002 m ² /J	- Increasing RH associated with increasing susceptibility.
McDevitt (2007) ¹¹ USA	Vaccinia virus (strain WR) - enveloped - dsDNA (p.5763)	Wavelength: 254 nm Dose: 0.1 - 3.2 J/m ² Exposure time: 7.6 s RH: 18%-23%RH, 58%-63%RH, 78%-83%RH Chamber: Benchtop In-duct UVGI	Dose-response Susceptibility (Z) <i>Effect of RH</i>	In SRF, at 18%-23%RH, Z=6.16 (4.27-8.89) m ² /J; at 58%-63%RH, Z=1.94 (1.66-2.26) m ² /J; At 78%-83%RH Z=1.63 (1.14-2.32) m ² /J; In water, at 18%-23%RH, Z=9.48 (5.32-16.90) m ² /J; at 58%-63%RH, Z=2.54 (2.05-3.16) m ² /J; at 78%-83%RH Z=1.42 (1.15-1.75) m ² /J -Z significantly lower at higher RH after controlling for medium. -Medium significant overall after controlling for RH.	- Increasing dose associated with decreasing survival fraction. - Increasing RH associated with decreasing susceptibility.
Su (2007) ⁵⁸ USA	Fluorescent bioaerosols	Safety requirement for occupants: 0.002 W/m ²	Fluorescent bioaerosol counts (FBC)	For 20 days evaluated, 12 days had significantly lower FBC in UVGI rooms compared with non-UVGI rooms, 6 days had	- UV radiation associated with reduction of fluorescent bioaerosol counts

Ultraviolet radiation and virus transmission

		Setting: Public elementary school Upper-room UVGI		<i>significantly</i> greater FBC in UVGI rooms than non-UVGI rooms, and 2 days were <i>not statistically different</i> between UVGI and non-UVGI rooms.	(FBC) on 12 days of the 20 days evaluated.
First (2007) ⁴¹ ; Rudnick (2007) ⁴² USA	Vaccinia virus (Western Reserve strain)	Wavelength: 254 nm Mean Room Fluence Rate (Rudnick, 2007 ⁴²) 0.0177 W/m ² ; 0.140 W/m ² RH: 50%RH Chamber: room Upper-room UVGI	Survival fraction (SF) Equivalent ACH (ACHuv) Susceptibility (Z)	At 0.0177 W/m ² , SF = 0.10 ± 0.05 ACHuv = 19.0 ACH At 0.140 W/m ² , SF = 0.04 ± 0.02 ACHuv = 42.8 ACH Z = 1.0 m ² /J [First (2007) ⁴¹ p.325; Rudnick (2007) ⁴² p.356, p.362]	- Increasing fluence rate (related to increasing dose) associated with decreasing survival fraction and increasing equivalent ACH.
McDevitt (2008) ¹² USA	Vaccinia virus (Western Reserve strain)	Wavelength: 254 nm Number of fixtures: 1, 4 ACH: 2, 6 ACH Condition: Winter (40%RH, fan upwards); Summer (80%RH, fan downwards) Chamber: room [Note: same chamber as First (2007) and Rudnick (2007)] [For 6 ACH and 1 fixture, dose was 17 J/m ² and was expected to be 4-times higher with 4 fixtures (p.5)]. Upper-room UVGI	Survival fraction (SF) Equivalent ACH (ACHuv)	For Winter, 2 ACH and 1 fixture SF=0.017 (0.014-0.021) ACHuv=110 (93-140) ACH For Winter, 2 ACH and 4 fixtures SF=0.003 (0.002-0.005) ACHuv=580 (410-830) ACH For Winter, 6 ACH and 1 fixture SF=0.038 (0.032-0.046) ACHuv=150 (120-180) ACH For Winter, 6 ACH and 4 fixtures SF=0.006 (0.004-0.008) ACHuv=1000 (740-1400) ACH For Summer, 2 ACH and 1 fixture SF=0.087 (0.062-0.120) ACHuv=18 (15-30) ACH For Summer, 2 ACH and 4 fixtures SF=0.061 (0.053-0.071) ACHuv=31 (26-36) ACH For Summer, 6 ACH and 1 fixture SF=0.140 (0.120-0.160) ACHuv=38 (31-46) ACH For Summer, 6 ACH and 4 fixtures SF=0.078 (0.065-0.084) ACHuv=71 (58-86) ACH	- Increasing number of fixtures (related to increasing dose) associated with decreasing survival fraction and increasing equivalent ACH. - Increasing ACH associated with increasing survival fraction and increasing equivalent ACH. - Comparing Winter and Summer, increasing RH and changing fan direction associated with increasing survival fraction and decreasing equivalent ACH.
Terrier (2009) ³⁷ France	Influenza A (H5N2) [A/Finch/Engl and/2051/2021 (H2N5)]	Wavelength: 254 nm Chamber:	Survival Fraction (SF) from efficiency	Influenza A (H2N5) SF = 0.0040 hPIV-3 SF = 0.0003 RSV	- UV radiation associated with survival fraction.

Ultraviolet radiation and virus transmission

	human parainfluenza 3 (hPIV-3) Respiratory syncytial virus (RSV)	experimental duct In-duct UVGI		SF = 0.0080	
McDevitt (2012) ¹³ USA	Influenza A (H1N1) [A/PR/8/34 H1N1] - RNA (p.1668)	Wavelength: 254 nm Dose: 4.9 - 15 J/m ² RH: 25%-27%RH, 50%-54%RH, 81%-84%RH Chamber: benchtop In-duct UVGI	Dose-response Susceptibility (Z) <i>Effect of RH</i>	At 25%-27%RH, Z=0.29 (0.27-0.31) m ² /J At 50%-54%RH, Z = 0.27 (0.26-0.31) m ² /J At 81%-84%RH, Z = 0.22 (0.21-0.23) m ² /J - Z significantly lower at higher RH	- Increasing dose associated with decreasing fraction surviving. - Increasing RH associated with decreasing susceptibility.
Cutler (2012) ³³ USA	Porcine Reproductive and Respiratory Syndrome Virus (PRRSV)	Wavelength: 254 nm Dose: 0, 0.5, 1.2, 2 J/m ² Exposure time: 0, 0.07, 0.14, 0.25 s RH: ≤24%RH, 25%-79%RH, ≥80%RH (Note: large range of RH for 25%-79%RH) Chamber: two reservoirs In-duct UVGI	Dose-response Susceptibility (Z) <i>Effect of RH</i>	At ≤24%RH, Z=0.425 m ² /J At, 25-79%RH Z=0.587 m ² /J At ≥80%RH, Z=0.341 m ² /J - Z significantly lower at ≥80%RH compared with 25%-79%RH.	-Increasing dose associated with decreasing survival fraction. - Increasing RH associated with decreasing susceptibility comparing 25%-79%RH with ≥80%RH.
Verreault (2015) ⁴⁰ Canada	MS2 (ssRNA) [15597-B1] phiX174 (ssDNA) phi6 (dsRNA, enveloped) PR772 (dsDNA)	Wavelength: 254 nm Dose: UV sensor data not reported Exposure time: 3 s, 6 s, 10 s RH: 20%RH Chamber: rotating drum	Relative Infectious Ratio (Note: relative infectious ratio appears to be equivalent to survival fraction)	- Relative infectious ratio significantly lower at higher exposure time. - MS2 (ssRNA) greater relative infectious ratio compared with other bacteriophages.	- Increasing exposure time associated with decreasing relative infectious ratio.
Lin (2017) ³⁵ Canada	phi6 - RNA (p.555)	Pulsed UVGI Wavelength: 200-280 nm Cumulative dose: 14, 28, 43 J/m ² RH: 41%-58%RH Chamber: cubic chamber with 1.8 m sides Upper-room UVGI	“fast decay” Survival fraction (SF) Susceptibility (Z) (Susceptibility calculated from survival fraction, not dose-response.) “slow decay” Dose-response Susceptibility (Z)	“fast decay” SF=0.035 ± 0.024 Z=0.24 m ² /J “slow decay” Z=0.02 m ² /J	- Increasing dose associated with decreasing survival fraction.

Ultraviolet radiation and virus transmission

Welch (2018) ³⁴ USA	Influenza A (H1N1) [A/PR/8/34 {H1N1}]	Wavelength: 222 nm Dose: 0, 8, 13, 20 J/m ² RH: 55%RH Chamber: Benchtop In-duct UVGI	Dose-response Susceptibility (Z)	Z=0.18 (0.15-0.21) m ² /J	- Increasing dose associated with decreasing survival fraction.
Buonanno (2020) ¹⁵ USA	Coronavirus 229E Coronavirus OC43 229E -alpha (p.2) OC43 -beta (p.2) SARS-CoV-2 - beta (p.2)	Wavelength: 222 nm Dose: 0, 5, 10, 20 J/m ² RH: 66%RH Chamber: Benchtop In-duct UVGI	Dose-response Susceptibility (Z)	Coronavirus 229E Z=0.41 (0.25-0.48) m ² /J Coronavirus OC43 Z=0.59 (0.38-0.71) m ² /J	- Increasing dose associated with decreasing survival fraction.
Pearce-Walker (2020) ³⁹ USA	MS2 [15579-B] canine distemper virus (CDV)	Wavelength: 253.7 nm 2 sets of 2 lamps @ 0.6 W/m ² RH: 12%-50%RH Chamber: HVAC duct In-duct UVGI	Survival fraction (SF) from log reduction (For CDV, log reduction calculated using lower detection limit = 3.16 TCID ₅₀ /mL)	MS2 SF=0.003 CDV SF<0.03	- UV radiation associated with survival fraction.
Qiao (2020) ³⁸ USA	Porcine respiratory coronavirus [VR-2384] -alpha (p.B; p.E)	Wavelength: 252.7±1 nm Dose: 139.2, 202.8, 496.3 J/m ² Exposure time: 1.25, 1.81, 4.44 s RH: 57%-62%RH Chamber: wind tunnel In-duct UVGI	Survival fraction (SF) from efficiency (Efficiency calculated using lower detection limit = 3.16 x10 ¹ TCID ₅₀ /mL)	SF<0.0060 at 139.2 J/m ² SF<0.0004 at 202.8 J/m ² SF<0.0002 at 496.3 J/m ²	- UV radiation associated with survival fraction.

Data reported as (95% confidence interval) or ± standard deviation.

ssRNA = single-stranded ribonucleic acid; ssDNA = single-stranded deoxyribonucleic acid;

dsRNA = double-stranded ribonucleic acid; dsDNA = double-stranded deoxyribonucleic acid

Ultraviolet radiation and virus transmission

Table 4. Summary of characteristics and findings for modelling studies of UV treatments

Author (Year) Country	Infectious Agent	Model	Outcome Parameter	Data	Association
Noakes (2006) ⁴⁷ UK	Infectious agents sensitive to UV radiation including viruses	UV device and ventilation configuration Setting: single patient hospital room CFD model Upper-room UVGI	UV dose distribution Volume average UV dose where volume could be room, upper-room or lower-room	- Higher average UV dose in the occupied region of the room when ventilated air supplied at floor and extracted at ceiling compared with supplied at ceiling and extracted at floor. - UV dose less affected by UV device location when ventilated air supplied at floor and extracted at ceiling compared with supplied at ceiling and extracted at floor.	- UV dose affected by airflow pattern. - UV dose affected by UV device location.
First (2007) ⁴¹ ; Rudnick (2007) ⁴² USA	Vaccinia virus (Western Reserve strain)	Wavelength: 254 nm Mean Room Fluence Rate (Rudnick, 2007 ⁴²) 0.0177 W/m ² ; 0.140 W/m ² RH: 50%RH Two box model Upper-room UVGI	Survival fraction (SF) Effectiveness index (EI) which considers vertical mixing and UV radiation	At 0.0177 W/m ² , SF = 0.10 EI = 18.2 At 0.140 W/m ² , SF = 0.04 EI = 36.4	- Survival fraction (SF) proportional to Effectiveness index (EI) to the -0.74 power. - Increasing fluence rate (related to increasing dose) associated with decreasing survival fraction and increasing EI.
Li (2010) ⁴³ South Korea	Infectious agents sensitive to UV radiation including viruses	UV device configuration: wall, corner Fluence rate: 0, 59, 118, 236 W/m ² ventilation: 0, 3, 6 ACH Evaluated Z=0.059 m ² /J (p.51) Setting: hospital isolation room CFD model Upper-room UVGI	Survival fraction (SF) from efficiency (removal SF equals UV radiation SF plus ventilation SF)	-Removal SF lower when UV on wall compared with corner -Removal SF lower with increasing fluence rate - Removal SF lower with increasing ACH - Ventilation SF lower with increasing ACH - UV radiation SF greater with increasing ACH	- UV dose and survival fraction affected by UV device location. - Increasing fluence rate (related to increasing dose) associated with decreasing removal survival fraction. - Increasing ACH associated with increasing UV radiation survival fraction. - Increasing ACH associated with decreasing removal survival fraction and decreasing ventilation survival fraction.

Ultraviolet radiation and virus transmission

Sung (2011) ⁴⁵ Japan	Influenza	UV device configuration Evaluated $Z=0.27 \text{ m}^2/\text{J}$ for influenza A (p.2328) [see McDevitt (2012) ¹³] Setting: four patient hospital room CFD model Upper-room UVGI	UV dose distribution Survival fraction (SF)	- In breathing zone of neighbouring patient, SF = 0.26 - 0.52 - Highest UV dose and lowest survival fraction when upper-room UVGI installed on opposite side of the one exhaust opening.	UV dose affected by UV device location.
Zheng (2016) ⁴⁸ USA/ China	Influenza	UVGI equivalent air changes per hour ACH _{uv} = 12 ACH SIER epidemic model and contact network model UVGI on cruise ship	Attack rate = Number of new cases in population at risk divided by number of persons at risk in population	Attack rate decreased 87.8% with UVGI compared with baseline (no UV).: 4.08% compared with 33.42%	UV radiation associated with decreased attack rate (related to number of cases).
Firrantello (2018) ⁴⁶ USA	Rhinovirus	Coil face: $2 \text{ W}/\text{m}^2$ Allowable minimum: $0.50 \text{ W}/\text{m}^2$ Evaluated $Z=0.02996 \text{ m}^2/\text{J}$ for virus (p.604) Parametric model of energy, indoor air quality (IAQ), economic benefits UVGI of cooling coil (in-duct UVGI)	IAQ benefit: Work Loss Days (WLD); Hospital Acquired Infections (HAI); Disability Adjusted Life Years (DALY)	“The estimated monetary IAQ benefit from collateral air treatment of a UVGI coil irradiation system treatment was much greater than the estimated energy cost savings.” (p. 609)	UV radiation of coils associated with monetary indoor air quality benefit related to absence, infection, or disability.
Buchan (2020) ⁴⁴ UK	Coronavirus	Wavelength: 222 nm Evaluated $Z=0.41 \text{ m}^2/\text{J}$ for coronavirus (Buonanno, 2020 ¹⁵) (p.2) Setting: single patient hospital room Coupled radiation-CFD model Upper-room UVGI	Survival fraction (SF)	At 0.8 ACH, SF = 0.15 At 8 ACH, SF = 0.43	Increasing ACH associated with increasing survival fraction.

CFD = computational fluid dynamics

SEIR = susceptible-exposed-infected-recovered

Ultraviolet radiation and virus transmission

Table 5. Summary of characteristics and findings for animal studies of UV treatments

Author (Year) Country	Infectious Agent	Treatment	Outcome Parameter	Data	Association
Wells (1936) ⁴⁹ USA	Influenza [Puerto Rico 8]	Dose: UV light intensity previous “marked bactericidal effect” (p.412) Setting: virus aerosolizing and animal exposure chamber; treatment tube In-duct UVGI	Transmission Air from UV group and non-UV group inoculated intranasally.	Transmission in 0 of 2 ferrets in UV group and 2 of 2 ferrets in non-UV group.	UV radiation associated with decreased transmission.
Jakab (1982) ⁵⁰ USA	Influenza A [Mouse-adapted influenza A/PR8/34]	Dose: 4.2, 8.4, 12.6 J/m ² * Setting: virus aerosolizing chamber; treatment slot; animal exposure chamber In-duct UVGI	Transmission	9% mortality of mice in highest dose UV group compared with 100% mortality of mice in non-UV group.	- UV radiation associated with decreased mortality. - Increasing UV dose associated with decreasing mortality.
Dee (2006) ⁵² USA	Porcine Reproductive and Respiratory Syndrome Virus (PRRSV)	Wavelength: 253.7 nm Setting: virus aerosolizing chamber; treatment duct; animal exposure chamber In-duct UVGI	Transmission	Transmission in 8 of 10 pigs in UV group <i>not statistically different</i> than transmission in 9 of 10 pigs in non-UV group likely due to insufficient exposure time (p.32).	UV radiation did not have a statistically significant effect on transmission likely due to insufficient exposure time (related to UV dose).
Jaynes (2020) ⁵¹ USA	Upper respiratory tract infections (URI)	Dose: designed to eliminate 99% of influenza, feline calicivirus, and bacteria <i>B bronchiseptica</i> (p.930) Setting: Kitten nursery Upper-room UVGI	Incidence of URI	Incidence of URI <i>significantly</i> decreased 87.1% with UVGI in 2018 compared with no UVGI in 2016: 1.6 cases per 100 kitten admissions compared with 12.4 cases per 100 kitten admissions.	UV radiation associated with decreased incidence of upper respiratory tract infections.

* inconsistencies in units for dose appear to be typos in the original paper, we assumed these to be 420, 840 and 1260 $\mu\text{J}/\text{cm}^2$

Ultraviolet radiation and virus transmission

Table 6. Summary of characteristics and findings for human studies of UV treatments

Author (Year) Country	Infectious Agent	Treatment	Outcome Parameter	Data	Association
Wheeler (1945) ⁵³ USA	Respiratory Infections	Naval Training Centre Barracks High intensity: 235 W UV energy per dormitory Low intensity - 121 W UV energy per dormitory Upper-room UVGI and floor UVGI	Transmission Mean number of admissions for respiratory illness per company	High Intensity - Non-UV: 12.4 UV: 9.3 - Cases in UV group <i>significantly</i> lower than cases in non-UV group Low Intensity - Non-UV: 11.4 UV: 11.3 - Cases in UV group <i>not statistically different</i> than cases in non-UV group	- UV radiation associated with decreased transmission with high intensity UV treatment. - UV radiation not associated with altered transmission with low intensity UV treatment.
Perkins (1947) ⁵⁴ USA	Measles virus	Face level of standing pupil: 0.002-0.005 W/m ² Upper-room air: 0.11-0.22 W/m ² School with UV and non-UV rooms Upper-room UVGI	Transmission Days for onset of middle 80% of cases	Non-UV: 17 days UV: 24 days - Protracted spread in UV rooms and explosive spread in non-UV rooms.	UV radiation associated with modified spread of transmission for measles.
Higgins (1947) ⁵⁵ USA	Respiratory Infections	UVGI system equivalent to at least 100 ACH Wavelength: 253.7 nm Hospital children's wing Upper-room UVGI	Transmission Number of children febrile from respiratory disease	Non-UV: 3.98% of children in three-year control period UV: 2.38% of children febrile in three-year treatment period -difference not attributed to chance	UV radiation associated with decreased transmission.
Langmuir (1948) ⁵⁶ USA	Respiratory Infections	Naval Training Centre Barracks Upper-room UVGI and floor UVGI Pre-pandemic Pandemic (Influenza A) Post-pandemic	Transmission Mean incidence rates per 1,000 per week of febrile respiratory diseases	Pre-pandemic - Non-UV: 9.5 UV: 4.9 Pandemic - Non-UV: 85.6 UV: 69.6 Post-pandemic - Non-UV: 19.1 UV: 16.7 - pre-pandemic difference not attributed to chance.	UV radiation associated with decreased transmission.

Ultraviolet radiation and virus transmission

<p>Bahlke (1949)⁵⁷ USA</p>	<p>Chickenpox Mumps</p>	<p>Face level of standing pupil: 0.002-0.005 W/m² Upper-room air: 0.11-0.22 W/m²</p> <p>School with UV and non-UV rooms</p> <p>Upper-room UVGI</p> <p>[Note: Same methods as Perkins (1947)]</p>	<p>Transmission</p> <p>Days for onset of middle 80% of cases</p>	<p>Chickenpox Non-UV: 49 days UV: 78 days</p> <p>Mumps Non-UV: 53 days UV: 54 days</p> <p>- Explosive spread not observed in UV rooms.</p>	<p>- UV radiation associated with modified spread of transmission for chickenpox. - UV radiation not associated with modified spread of transmission for mumps.</p>
---	-----------------------------	--	--	--	---

Ultraviolet radiation and virus transmission

Table 7. Risk of Bias for Experimental Studies

Study	Selection Bias	Information Bias	Confounding*
<i>Aersolized Virus</i>			
Jensen (1964) ³⁶	low	unclear	low
Tseng (2005) ³²	low	low	low
Walker (2007) ¹⁰	low	low	low
McDevitt (2007) ¹¹	low	low	low
Su (2007) ⁵⁸	low	high	high
First (2007) ⁴¹	low	low	low
McDevitt (2008) ¹²	low	low	low
Terrier (2009) ³⁷	low	unclear	low
McDevitt (2012) ¹³	low	low	low
Cutler (2012) ³³	low	low	low
Verreault (2015) ⁴⁰	low	unclear	low
Lin (2017) ³⁵	low	low	low
Welch (2018) ³⁴	low	low	low
Buonanno (2020) ¹⁵	low	low	low
Pearce-Walker (2020) ³⁹	low	unclear	low
Qiao (2020) ³⁸	low	low	low
<i>Animal Studies</i>			
Wells (1936) ⁴⁹	low	unclear	low
Jakab (1982) ⁵⁰	low	low	low
Dee (2006) ⁵²	low	unclear	low
Jaynes (2020) ⁵¹	low	low	low
<i>Human Studies</i>			
Wheeler (1945) ⁵³	low	low	low
Perkins (1947) ⁵⁴	low	low	low
Higgons (1947) ⁵⁵	low	low	low
Langmuir (1948) ⁵⁶	low	unclear	low
Bahlke (1949) ⁵⁷	low	low	low

* Confounding assessed for our comparison of interest.

Table 8. Risk of Bias for Modelling Studies

Study	Definition	Assumption	Validation
Noakes (2006) ⁴⁷	low	low	low
Rudnick (2007) ⁴²	low	low	low
Li (2010) ⁴³	low	low	low
Sung (2011) ⁴⁵	low	low	low
Zheng (2016) ⁴⁸	low	low	low
Firrantello (2018) ⁴⁶	low	low	low
Buchan (2020) ⁴⁴	low	low	low

Ultraviolet radiation and virus transmission

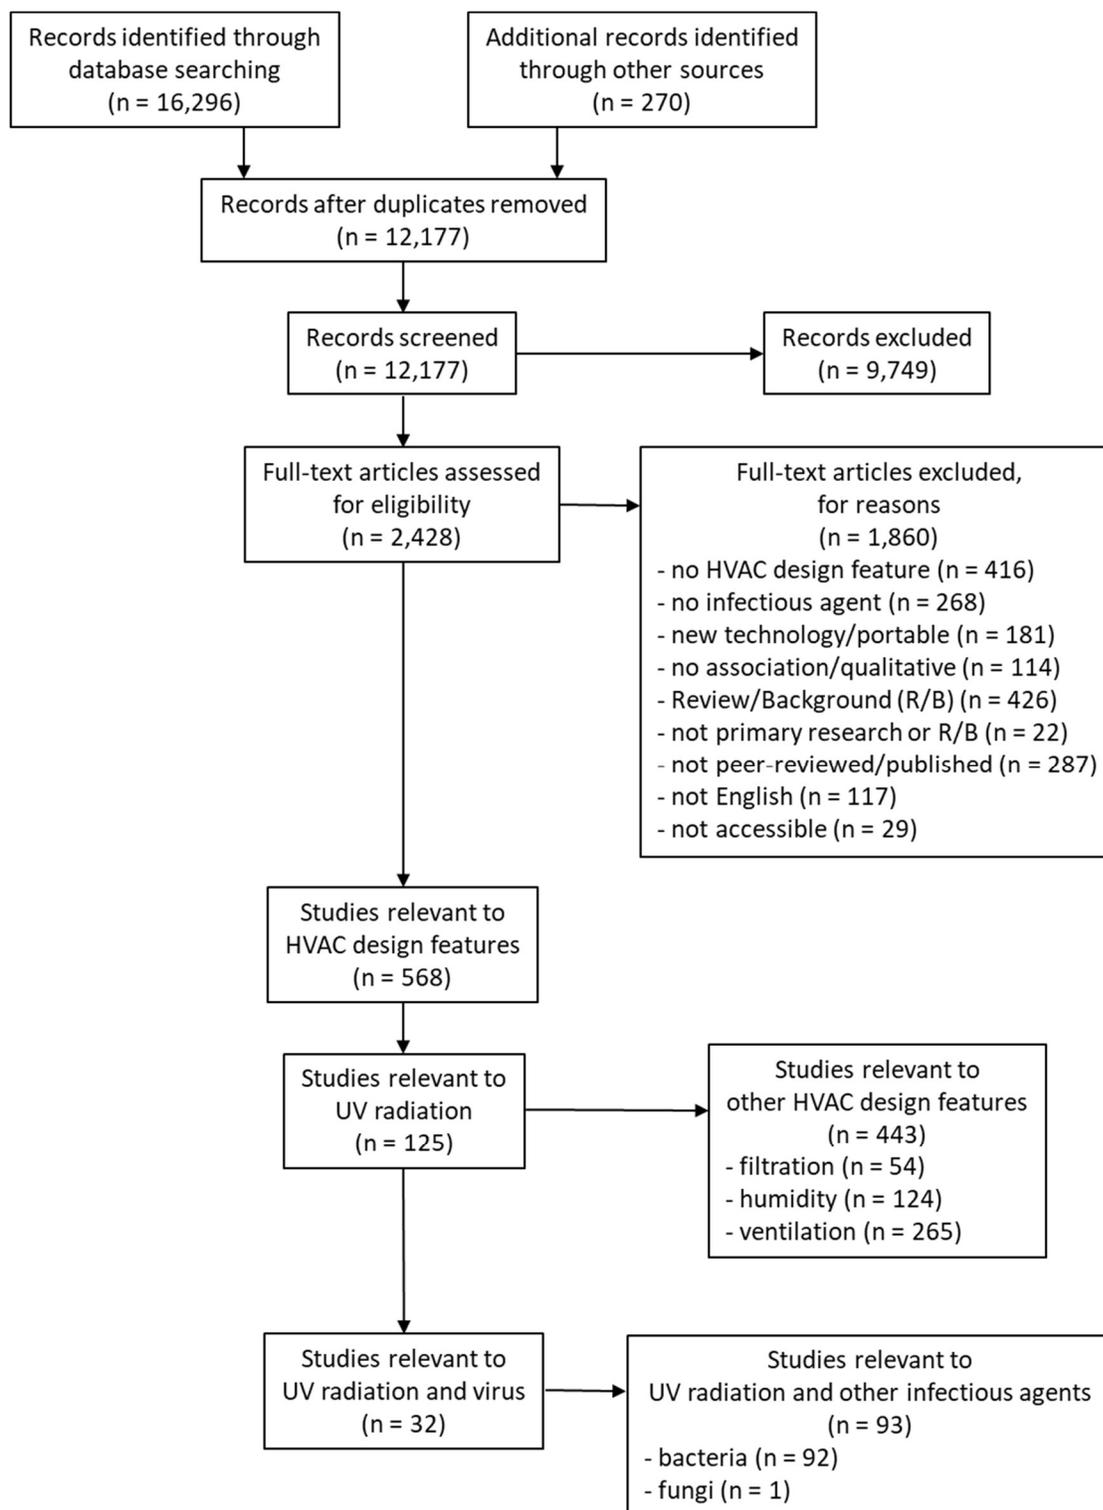


Figure 1. Flow of studies through the selection process (note: search was conducted for all HVAC design features but only studies of UV radiation are included in this manuscript).

Ultraviolet radiation and virus transmission

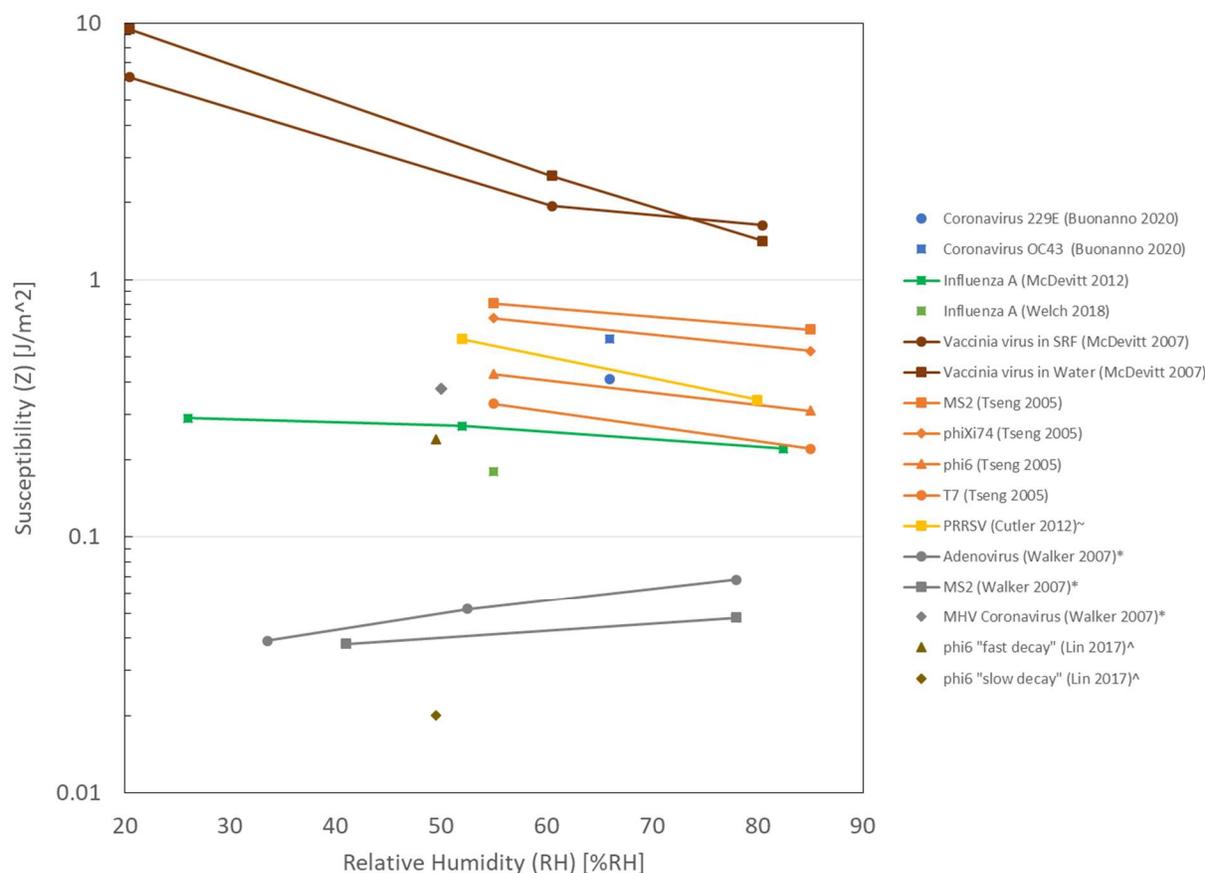


Figure 2. UV radiation susceptibility (Z) and relative humidity (RH)

Each colour represents one study. Reported RH ranges shown as average RH values.

~Cutler at al³³ reported that susceptibility (Z) was significantly lower at $\geq 80\%RH$ (shown at $80\%RH$) compared with $25\%-79\%RH$ (shown at $52\%RH$).

*Walker and Ko¹⁰ calculated susceptibility from a single dose and corresponding survival fraction, rather than dose-response of UV dose and survival fraction.

^ Lin et al³⁵ calculated susceptibility from a single dose and corresponding survival fraction for “fast decay” and from the dose-response of UV dose and survival fraction for “slow decay”.