

Supplementary Material

Table S1: Results of RT-qPCRs across nCoVPC plasmid control concentrations

Target descriptive	Level concentrations (viral copies/uL)	Number of Positive Hit Counts	Total Test Counts
N1	100,000	26	26
N1	50,000	3	3
N1	20,000	33	33
N1	2,000	33	33
N1	200	33	33
N1	20	33	33
N1	10	20	21
N1	2	11	33
N2	100,000	26	26
N2	50,000	3	3
N2	20,000	33	33
N2	2,000	33	33
N2	200	33	33
N2	20	33	33
N2	10	18	21
N2	2	17	33

Table S2: qRT-PCR results for pooled 3D-NMT swabs and concurrently collected individual flocked NMT swabs. Pools, and their comprising individuals, are denoted by shaded rows. Individuals of the household who were not available for pooling are marked as not applicable. 24 pools and 106 individual swabs were collected.

Family ID	Subject ID	Ct value	Avg viral RNA copies/uL (NMT)	Pool result +/-	Ct Value of Pool	Average viral RNA copies/uL of pool	Family ID	Subject ID	Ct value	Avg viral RNA copies/uL (NMT)	Pool result +/-	Ct Value of Pool	Average viral RNA copies/uL of pool
COV004 D21	COV004	undet	0	-	undet	0	COV030 D22	COV030	undet	0	indet	37	3
	COV004-001	undet	0					COV030-001	undet	0			
	COV004-002	undet	0					COV030-002	undet	0			
	COV004-004	undet	0					COV030-003	undet	0			
COV012 D1	COV012	29	2,439	+	23	54,917	COV032 D7	COV032	32.5	66	-	undet	0
	COV012-001	27	7,196					COV032-001	undet	0			
	COV012-002	21.5	144,769					COV032-002	undet	0			
	COV012-003	26	8,223					COV032-003	undet	0			
	COV012-004	23.5	55,478					COV032	34	24			
COV017 D1	COV017	28	3,603	+	23	99,275	COV032 D21	COV032-001	undet	0	-	undet	0
	COV017-001	23	135,846					COV032-002	undet	0			
	COV017-002	30	518					COV032-003	undet	0			
	COV017-003	22.5	162,938					COV033	undet	0			
	COV017-004	21.5	481,149					COV033-001	undet	0			
COV020 D22	COV020	undet	0	indet	38.5	4	COV033 D7	COV033-002	undet	0	-	undet	0
	COV020-001	undet	0					COV033-003	undet	0			
	COV020-002	undet	0					COV033-004	undet	0			
	COV020-003	undet	0					COV041	undet	0			
	COV020-004	39.5	3					COV041-001	20	371,312			
COV021 D14	COV021	undet	0	-	undet	0	COV041 D7	COV041-002	36.5	4	+	24	28,967
	COV021-001	undet	0					COV041-003	undet	0			
	COV021-002	undet	0					COV041-004	undet	0			
	COV021-003	undet	0					COV041-005	undet	0			
	COV021-004	undet	0					COV045	undet	0			
COV021 D21	COV021	undet	0	-	undet	0	COV045 D7	COV045-001	undet	0	-	undet	0
	COV021-001	undet	0					COV045-002	undet	0			
	COV021-002	undet	0					COV045-003	n/a	n/a			
	COV021-003	undet	0					COV049	32	607			
	COV021-004	undet	0					COV049-001	27.5	59,704			
COV026 D7	COV026	undet	0	-	undet	0	COV049 D7	COV049-002	27.5	19,719	+	22	9,468
	COV026-001	undet	0					COV049-003	24.5	892,519			
	COV026-002	undet	0					COV051	undet	0			
	COV026-003	undet	0					COV051-001	undet	0			
	COV026-004	undet	0					COV051-002	undet	0			
COV026 D14	COV026	undet	0	-	undet	0	COV051 D9	COV051-003	undet	0	-	undet	0
	COV026-001	undet	0					COV051-004	undet	0			
	COV026-002	undet	0					COV052	21	270,034			
	COV026-003	undet	0					COV052-001	undet	0			
	COV026-004	undet	0					COV052-002	undet	0			
COV027 D7	COV027	31	298	+	33.5	34	COV052 D1	COV052-003	34.5	22	+	21.5	152,869
	COV027-001	35	24					COV052	33	69			
	COV027-002	35	21					COV052-001	undet	0			
	COV027-003	35.5	16					COV052-002	undet	0			
COV027 D14	COV027	undet	0	indet	36	7	COV052 D8	COV052-003	undet	0	+	34.5	14
	COV027-001	36.5	7					COV055	undet	0			
	COV027-002	33.5	31					COV055-001	37.5	9			
	COV027-003	undet	0					COV055-002	28	3,800			
COV029 D8	COV029	undet	0	+	31.5	131	COV055 D8	COV055-005	n/a	n/a	+	27	6,152
	COV029-001	38	5					COV059	undet	0			
	COV029-002	35	29					COV059-001	27	8,367			
	COV029-003	22	134,705					COV059-002	undet	0			
COV030 D8	COV030	29	1532	+	28.5	2183	COV059 D8	COV059-003	undet	0	+	27	6,417
	COV030-001	undet	0					COV059-004	undet	0			
	COV030-002	28	2767										
	COV030-003	37.5	5										

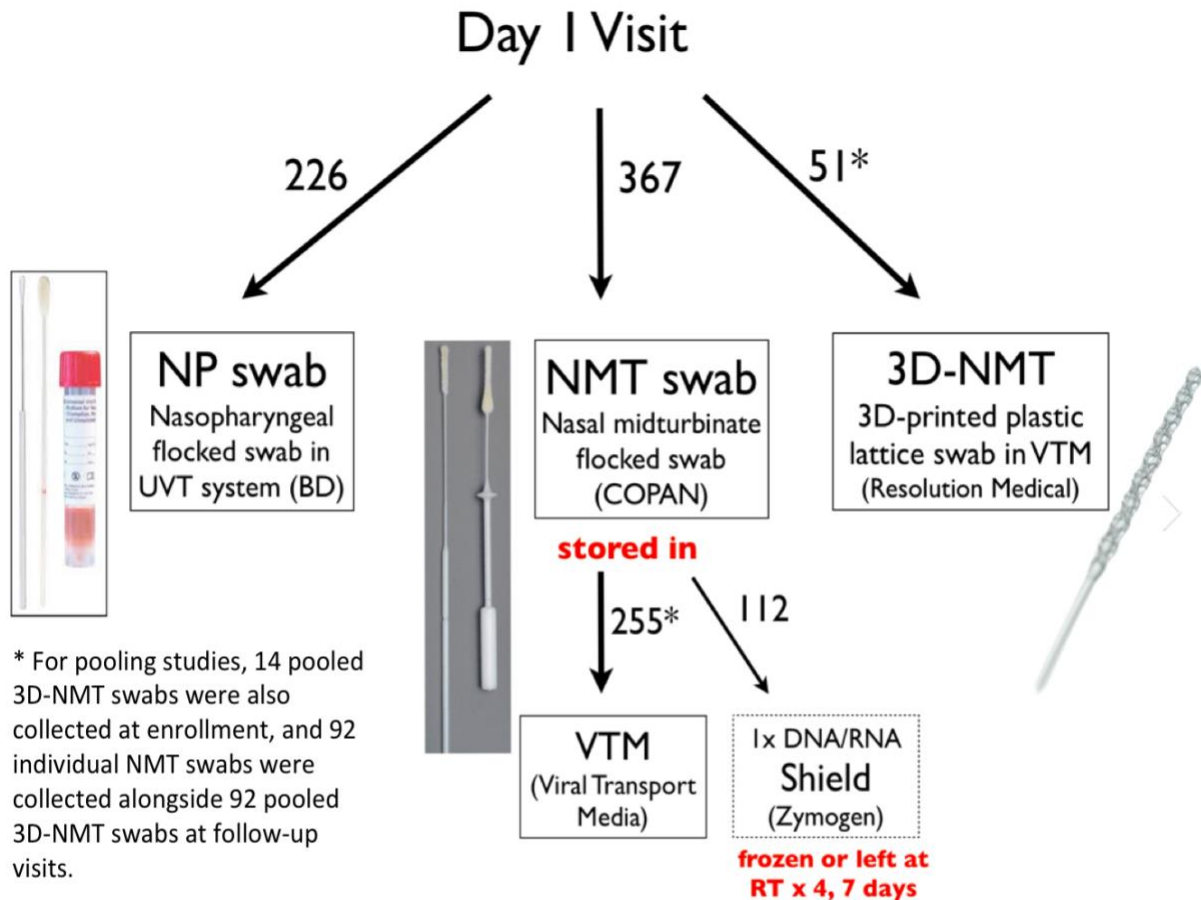


Figure S1. Schematic of swab collection strategies at enrollment. For each study participant at enrollment, a nasopharyngeal (NP) swab was collected as the gold standard diagnostic test. Up to 2 nasal midturbinate swabs - flocced COPAN swabs (NMT) and/or 3D-printed plastic lattice swabs (3D-NMT) - were concurrently collected, one from each nostril, for comparison. 3D-printed swabs were autoclaved before use per manufacturer's instructions

Swabs were either stored in viral transport media (VTM) or 1x DNA/RNA Shield (1xShield). Samples stored in 1xShield were further analyzed via aliquots that were either immediately frozen (D1 Shield) or left out at room temperature for 4 or 7 days (D4 Shield, D7 Shield) before storage at -80°C. A total of 620 individual swabs were collected at enrollment, while 184 swabs were collected to test pooling at follow-up visits.

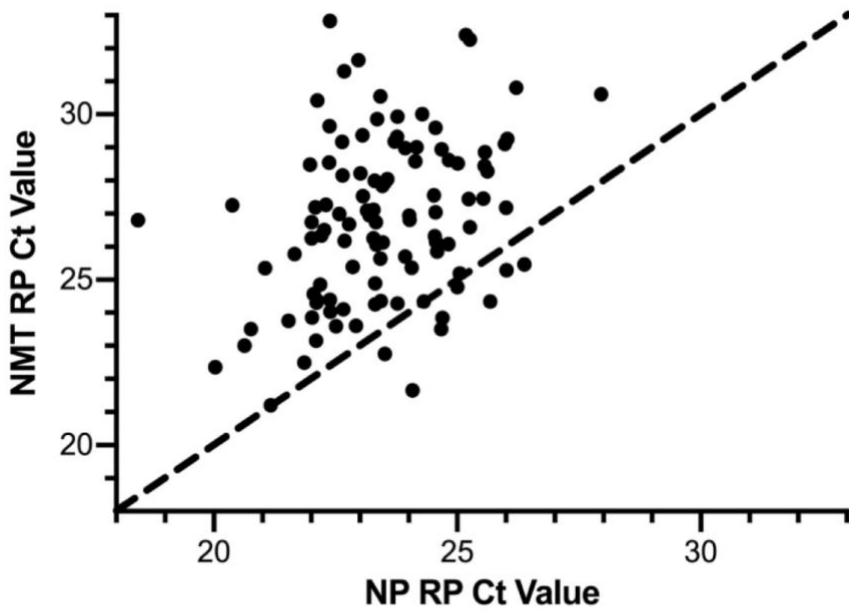


Figure S2. Comparison of human RPP30 gene (RP) cycle threshold (Ct) values from paired nasopharyngeal (NP) and nasal mid-turbinate (NMT) swabs. Higher RP Ct values were observed in NMT swabs compared to NP swabs with an average Ct value difference of 3.1 cycles, suggesting better sampling. A $y=x$ line is drawn for reference.